



# Quality guidelines for wood fuels in Finland – 2020

VTT-M-04712-15



The Bioenergy Association of Finland  
Eteläranta 10  
FI-00130 Helsinki, Finland  
[www.bioenergia.fi](http://www.bioenergia.fi)

Finnish Energy  
Eteläranta 10  
FI-00130 Helsinki, Finland  
[www.energia.fi](http://www.energia.fi)

Finnish Forest Industries Federation  
Snellmanninkatu 13  
FI-00171 Helsinki, Finland  
[www.forestindustries.fi](http://www.forestindustries.fi)

## Foreword

The quality guidelines for wood fuels in Finland are intended for the producers, suppliers, and users of wood fuels to guide them in classifying and determining the quality of wood fuels. These guidelines can also assist the authorities, for instance, in emissions trading and the application of feed-in tariffs on wood fuels.

This publication is a translation of the publication: “Puupolttoaineiden laatuohje – VTT-M-07608-13 – Päivitys 2020”. EN ISO standards published in 2014 have been updated in this publication.

Main changes are: a list of analysis standards have been updated (Table 1), new ISO/TS 17225-9 have been added, fuel classification numbers of Statistics Finland have been updated, Tables 3, 4 and 5 have been updated by the new quality requirements based on ISO 17225 series, fuel requirements for 50 MW plants have been added (LCP BREF), information about X-ray moisture measurement has been added, number of increments for HCT-trucks and volume of increment for wood chips produced from tops and branches have been changed to 5 L, Literature has been updated, Annex 3 has been updated according to the new requirements of particle size distribution.

Jyväskylä, 4 December 2020

Eija Alakangas

## Contents

Foreword .....	2
Contents .....	3
1. Introduction .....	5
2. Scope .....	6
3. Normative references .....	6
4. Terms and definitions .....	8
4.1 Wood fuels.....	8
4.2 Sampling, processing and analyses.....	10
5. Abbreviations, symbols and units of energy .....	12
6. Specification and classification of wood fuels.....	14
6.1. Principle of the specification of wood fuels .....	14
6.2 Specification of the classes .....	15
6.2.1 General principles .....	15
6.2.2 Classification by the origin of the raw material .....	15
7. Determining the quality grade .....	21
7.1 General .....	21
7.2 Moisture (M).....	21
7.3 Net calorific value as received ( $q_{p,net,ar}$ ) .....	22
7.4 Energy density as received ( $E_{ar}$ ) .....	23
7.5 Delivered energy (W) .....	23
7.6 Bulk density (BD) .....	24
7.7 Particle size distribution (P) .....	24
7.8 Other properties.....	24
8. Quality assurance of wood fuels .....	25
9. Sampling and the preparation of samples .....	26
9.1 General on sampling .....	26
9.2 Sampling scheme.....	27
9.3 Sampling location .....	27
9.4 Sampling procedure .....	28

9.4.1 General .....	28
9.4.2 Mechanical sampling.....	28
9.4.3 Manual sampling.....	30
9.5 The number and volume of increments .....	31
9.6 Sample preparation and processing .....	33
9.6.1 General .....	33
9.6.2 Combined samples .....	33
9.6.3 Sample preparation.....	34
<b>10. Legal provisions governing measuring.....</b>	<b>37</b>
<b>Literature .....</b>	<b>38</b>
<b>Annex 1 – Classification of wood raw materials (1.1 and 1.2) in accordance with standard SFS-EN ISO 17225-1.....</b>	<b>41</b>
<b>Annex 2 – Examples of product declarations of various wood fuels .....</b>	<b>42</b>
<b>Annex 3 – Determination of particle size .....</b>	<b>44</b>
<b>Annex 4 – Determination of moisture .....</b>	<b>46</b>
<b>Annex 5 – Net calorific value as received – calculation .....</b>	<b>47</b>
<b>Annex 6 – Determination of bulk density .....</b>	<b>48</b>
<b>Annex 7 – Example of the sampling and sample preparation for wood fuels .....</b>	<b>50</b>
<b>Annex 8 – Number of increments .....</b>	<b>51</b>
<b>Annex 9 – Quality diagram for wood fuels .....</b>	<b>52</b>

## 1. Introduction

Wood fuels are the most important source of renewable energy in Finland; its share of the total energy consumption in Finland was 28% in 2019.

The objective of these quality guidelines is to provide unambiguous and clear classification principles for solid wood fuels, provide guidance for the determination of their quality, and thus act as a tool to enable efficient trading of wood fuels and to enable good understanding between seller and buyer, and to also serve the needs of equipment manufacturers. These guidelines will also facilitate authority permission procedures and reporting.

These guidelines do not include the fuel specification of residential wood fuels. The fuel specification of standard SFS-EN ISO 17225-4 can be applied for this purpose. Pellets and briquettes are also excluded from these quality guidelines; their own quality standards (SFS-EN ISO 17225-2, SFS-EN ISO 17225-3, SFS-EN ISO 17225-6 and SFS-EN ISO 17225-7) are applied in the determination of their quality.

These guidelines can also be applied in the international trade of wood fuels.

The classification of wood fuels is based on the classification of a raw material's origin and source, and wood biomass (Class 1) can be divided into three main groups:

- 1.1 Woody biomass from forests, plantations and other virgin wood (Annex 1);
- 1.2 By-products and residues from the wood processing industry (Annex 1); and
- 1.3 Used wood

These guidelines concentrate on wood fuels sourced from forests, and wood by-products and residues from the wood processing industry. VTT has prepared a separate report and classification guidelines for used wood (Class 1.3). Practical application of the classification of used wood (VTT-M-01931-14, Alakangas, E. et al. 2015). When determining the quality of "clean" used wood (1.3.1), follow the principles of these guidelines and the additional quality criteria of the Guidelines of the classification of used wood (Alakangas, E. 2014, Alakangas, E. et al. 2015).

If the wood fuel is composed of blends, the percentage shares of the different fuels (as energy) must be determined before the fuels are mixed, and their percentage shares must be stated. If forest fuels and used wood or wood residue from the wood processing industry are mixed, the percentage of energy shares of raw materials from different origins must be stated. With regard to power plants belonging to the feed-in tariff system, the Energy Authority must approve a plant-specific monitoring plan, in which the determination of fuel energy contents is described, taking into consideration any mixtures or blends. Furthermore, if wood fuels and peat are mixed, the Quality guidelines for fuel peat (NT ENVIR 009) must be complied with in addition to these guidelines, and the requirements of emission trading must be taken into consideration.

## 2. Scope

The purpose of these guidelines is to specify a procedure for reporting and determining the quality and energy content of wood fuels in an unambiguous and purposeful manner.

## 3. Normative references

When determining quality, use the procedures listed in Table 1. When determining moisture content, other moisture content measurement methods (such as rapid moisture meters, on-line analysis by X-ray) can also be used when separately agreed, if their equivalence with the standard methods can be proven.

*Table 1. List of standards related to the determination of wood fuel characteristics<sup>1</sup>*

Property	Standard
Moisture content as received ( $M_{ar}$ )	Solid biofuels. Determination of moisture content. Oven dry method — Part 2: Total moisture — Simplified method (SFS-EN ISO 18134-2).
Ash content ( $A_d$ )	Solid biofuels. Method for determination of ash content (SFS-EN ISO 18122)
Calorific value ( $q_{p,net,d}$ )	Solid biofuels. Method for the determination of calorific value (SFS-EN ISO 18125)
Particle size distribution (P) and fines (F)	Solid biofuels. Determination of particle size distribution for uncompressed fuels - Part 1: Horizontally oscillating screen using sieve for classification of samples with a top aperture of 3.15 mm and above (SFS-EN ISO 17827-1)  Solid biofuels. Determination of particle size distribution for uncompressed fuels - Part 2: Vertically vibrating screen using sieve for classification of samples with a top aperture of 3.15 mm and below. (SFS-EN ISO 17827-2)
Bulk density (BD)	Solid biofuels. Determination of bulk density (SFS-EN ISO 17828)
Carbon (C), Hydrogen (H) and Nitrogen (N) content	Solid biofuels. Determination of total content of carbon, hydrogen, and nitrogen - Instrumental methods (SFS-EN ISO 16948)
Sulphur (S) and Chlorine (Cl) content	Solid biofuels. Determination of total content of sulphur and chlorine (SFS-EN ISO 16994)
Water soluble chloride (Cl), sodium (Na) and potassium (K) content	Solid biofuels. Determination of the water-soluble chloride, sodium, and potassium content (SFS-EN ISO 16995)
Major elements (Al, Si, K, Na, Ca, Mg, Fe, P and Ti)	Solid biofuels. Determination of major elements, (SFS-EN ISO 16967)
Minor elements (As, Ba, Be, Cd, Co, Cr, Cu, Hg, Mo, Mn, Ni, Pb, Se, Te, V and Zn)	Solid biofuels. Determination of minor elements, (SFS-EN ISO 16968)
Heavy extraneous materials (> 3,15 mm)	Solid biofuels — Determination of content of heavy extraneous materials larger than 3,15 mm (SFS-EN ISO 19743)

<sup>1</sup> the latest published versions of the standards are always used. During 2020– 2021, the standards will be updated. Check the latest version on [www.iso.org](http://www.iso.org)

Furthermore, the following standards are needed in quality classification, and the application of quality assurance, sampling, and sample preparation:

- SFS-EN 15234-1. Solid biofuels. Fuel quality assurance. Part 1: General requirements (referred to as "quality assurance standard part 1" in the text).
- SFS-EN 15234-4. Solid biofuels. Fuel quality assurance. Part 4: Wood chips for non-industrial use (referred to as "quality assurance standard part 4" in the text).
- SFS-EN ISO 18135. Solid biofuels. Sampling (referred to as "sampling standard" in the text)
- SFS-EN ISO 14780. Solid biofuels. Sample preparation (referred to as "sample processing standard" in the text).
- SFS-EN ISO 17225-1. Solid biofuels. Fuel specifications and classes. Part 1: General requirements. (referred to as "fuel specification standard part 1" in the text)
- SFS-EN ISO 17225-4. Solid biofuels. Fuel specifications and classes. Part 4: Graded wood chips (referred to as "fuel specification standard part 4" in the text)
- ISO/TS 17225-9. Solid biofuels. Fuel specifications and classes. Part 9: Graded hog fuel and wood chips for industrial use (for > 5 MW<sub>th</sub> plants)

## 4. Terms and definitions

### 4.1 Wood fuels<sup>2</sup>

#### **Bark (21.20.10)**

Residue derived from commercial timber by different debarking techniques.

#### **Blend**

contains intentionally mixed solid biofuels with a known composition or mixture ratio, based on either energy or weight.

NOTE: If the mixture ratio is defined based on volume, it must be converted to an energy-based ratio.

#### **Brown chips, dried chips**

Fuel chips made from dried and flushed felling residue (21.20.30) or a whole tree (21.10.20).

NOTE: The raw material of the wood chips has been dried in a pile for no less than six weeks between April and September, significantly reducing the amount of needles/leaves. The concentrations of chlorine or other alkali metals in the wood chips cannot be deduced from their colour.

#### **Chips, wood chips**

Woody biomass chipped into pieces of a certain size with sharp mechanical cutting blades. The wood chips are rectangular in shape, with their sides typically 5 to 50 mm in length and their thickness small compared to the other dimensions.

#### **Crown mass (21.20.30)**

By-product from commercial felling, comprising tops, branches, needles, and leaves. Crown mass is a synonym for tops and branches.

#### **Cutter shavings, planing shavings (21.20.40)**

Wood residue from planing of timber.

#### **Demolition wood (21.30.10)**

Used wood arising from demolition of buildings or civil engineering installations. Wood residues from the new construction of corresponding sites are recovered wood (21.50.10).

#### **Energy willow (21.10.50)**

Willow biomass grown for energy use through short rotation forestry.

#### **Forest chips**

Wood chips produced from forest biomass. In Finland, the term "forest chips" is used as a general term, referring to delimbed stem (21.10.20), whole tree (21.10.20) and felling residue chips (21.10.30).

#### **Forest wood fuel (21.10)**

Wood fuel produced with a mechanical process directly from wood raw material previously unused for any other purpose.

See stump, forest residue chips, forest chips, thinning wood and crown mass.

#### **Forest residue (21.20.30)**

Forest residue comprise logging residues left behind in the forest, such as branches and treetops, as well as small-diameter trees and thinning wood and cull trees left at felling sites.

#### **Fresh chips, green chips**

Fuel chips made from fresh felling residue or whole trees.

---

<sup>2</sup> The corresponding fuel classification number of Statistics Finland is within parentheses. Check the latest Finnish fuel classification of Statistics Finland from its website at <http://www.stat.fi/polttaineluokitus>



**Fuel chips; energy chips**

General term for wood chips used in combustion or other energy conversion, produced with different techniques.

**Fuel sawdust; fuel powder (21.20.40)**

Ground solid biofuel with particles typically 1 to 5 mm in size. For example, saw dust (21.20.20) and grinding dust (21.50.10).

**Hog fuel**

Wood fuel that has pieces of varying size and shape and produced by crushing with blunt tools such as rollers, hammers, or flails.

**Industrial wood residue**

Wood biomass residue from wood processing and the pulp and paper industry (bark, cross-cut ends, edgings, particleboard residue, fibre sludge, grinding dust, plywood residue, sawdust, cutting surfaces, slabs, and wood shavings).

**Mixture**

Contains unintentionally mixed solid biofuels, the origin of which is known, but the precise mixture ratio is unknown.

**Recovered wood (21.50.10)**

Clean wood residue classified as a solid biofuel or used wood or wood product, which does not contain plastic coatings or halogenated organic compounds and heavy metals more than virgin wood. For example, wood residue from new construction, pallets, wood packaging, etc.

**Roundwood (21.10.21 small-sized trees, 21.10.22 large sized timber)**

Delimbed trunk and logs that do not usually meet the requirements set for commercial timber. The term is primarily used for small-diameter timber.

**Sawdust (21.20.40)**

Small particles generated when wood is sawed.

NOTE. All three dimensions of most of the particles are in the range of a couple of millimetres except for random smaller particles, depending on the saw and the quality of the wood.

**Sawmill chips (21.20.30)**

Barked or debarked wood chips generated as a by-product of the sawmill industry.

**Short rotation wood (21.10.50)**

Woody biomass grown for raw material or energy usage in short rotation coppices with a five-to-eight-year rotation (e.g., energy willow).

**Stemwood (21.10.22 large-sized timber)**

A delimbed part of a tree trunk.

**Stump (21.10.20)**

The part of the stem below the felling cut, including the roots of the tree.

**Thinning wood (21.10.20)**

The part of the forest's growing stock removed during thinning, timber harvested during thinning.

**Whole tree (21.10.20, 21.10.21 small-sized trees, 21.10.22 large-sized timber)**

Felled, undelimbed tree, excluding its root system, which contains the stem with bark, branches, and needles/leaves.

**Wood residue**

Wood residue refers to wood generated during construction, demolition, and renovation activities (21.20.80, 21.50.10) and wood generated by the wood processing industry that may contain glue, paint, preservatives, and other such substances. Chemically untreated wood residue is classified into Class A, and chemically treated wood into Class B (21.50.10), if it does not contain more halogenated organic compounds or heavy metals from treatments with wood preservatives or coatings than virgin wood. Class A and B wood fuels can be classified according to standard SFS-EN ISO 17225-1, and the Government Decree on Waste Incineration will not be applied to them. The Solid Recovered Fuels standard (SFS-EN 15359) is applied to Class C wood fuels (wood waste), as is the Government Decree on Waste Incineration (151/2013).

**Wood residue chips (21.20.30)**

Chips from industrial barked and debarked wood residue (wood strips, offcuts, etc.) that do not contain painted or otherwise treated wood.

## 4.2 Sampling, sample preparation and analyses

**Combined sample**

General term for a sample formed by combining the increments taken from the same batch of fuel. A combined sample can also be formed by combining the sub-samples separated from homogenised increments into a single sample.

**Delivery lot**

The wood fuel batch on which the essential, regularly monitored quality requirements for wood fuels are focused. The size of the delivery lot is agreed on a case-by-case basis. The delivery lot can be an individual delivery lot, which is an agreed quantity of fuel (e.g. a package, shipload or truck load), or continuous delivery, where several loads are delivered to the end-user during an agreed period of time (usually daily or weekly delivery). If the delivery lot in continuous delivery is more than 1,500 to 2,000 m<sup>3</sup> in 24 hours, it is recommended that it should be divided into two or more sub-lots.

**General analysis sample**

A sub-sample of a laboratory sample having a nominal top size of 1 mm or less and used for several chemical and physical analyses.

**Increment**

The smallest amount of fuel extracted in a single operation to form the combined sample.

**Laboratory sample**

A sub-sample formed of combined samples collected from a delivery batch or its part by homogenisation and division, delivered to a laboratory for analysis. For comparison purposes, several parallel laboratory samples may be formed of the same combined sample, for example for determining moisture content. The laboratory sample may be prepared by the supplier of the sample, or it may be prepared by the laboratory from the delivered combined sample.

**Nominal top size**

In standard SFS-EN ISO 17827-1, the aperture of the sieve with round holes used in the determination of biofuel particle sizes, where at least 95% by mass of the material passes.

**Precision requirement**

The overall precision required for each significant characteristic of the delivery lot should be agreed between the parties. Should there be no such agreement, the values specified in these guidelines may be used (e.g.  $\pm 2$  to 4 percentage units for moisture). The overall precision must be achieved in sampling at a 95 per cent confidence level. Furthermore, the authorities may lay down precision requirements in, for example, the environmental and emission permits.

**Sample**

A quantity of material (all increments) representing a larger quantity, the quality of which needs to be determined.

**Sub-lot**

A portion of a lot for which a test result is required. The parties to the agreement may agree to divide the delivery lot into sub-lots to improve the assay precision or make the routines of the assay easier or quicker.

NOTE: When determining the size of the sub-lot, the sample processing equipment must be taken into consideration, or its size must be separately agreed.

**Sub-sample**

A portion of a sample, it becomes a test sample or test portion, if it is used for a test.

**Test portion**

Sub-sample either of a laboratory sample or a test sample

**Test sample**

laboratory sample after an appropriate preparation made by the laboratory

The standard SFS-EN ISO 16559. Solid biofuels. Terminology, definitions, and descriptions contains more term definitions.

**Other terms and classifications**

In the European List of Waste (2000/532/EC and 2014/995/EC), wood fuels delivered directly from the forest are classified as 02 01 07. Correspondingly, wood residues and by-products from the wood processing industry are classified as 03 01, the subclass 03 01 01 of which includes bark, and subclass 03 01 05 sawdust, shavings, cuttings, and particle board and plywood residue. Bark and wood residues from paper and pulp production are classified as 03 03 01. Wooden packaging is found in class 15 01 03, and demolition wood and wood residues from construction in class 17 02 01. European Commission has also published Commission notice on technical guidance on the classification of waste (2018/C124/01).

## 5. Abbreviations, symbols, and units of energy

A	Designation for ash content, $A_d$ (% in mass, dry basis) <sup>3</sup>
<i>ar</i>	as received
BD	Designation for bulk density as received [ $\text{kg}/\text{m}^3$ ] <sup>3</sup>
<i>d</i>	dry (dry basis)
$E_{ar}$	Energy density as received, $E_{ar}$ [ $\text{MWh}/\text{m}^3$ loose or stacked volume (amount of energy/volume unit)] <sup>3</sup>
E	Designation for energy density, [ $\text{MWh}/\text{m}^3$ , loose or stacked volume] <sup>3</sup>
F	Designation for amount of fines (% in mass as received); fines are separately stated in the particle size analysis. <sup>3</sup>
M	Moisture content as received, $M_{ar}$ [% in mass] wet basis <sup>3</sup>
P	Designation for particle size or particle size distribution as received, designation according to the main fraction <sup>3</sup>
$q_{p,net,d}$	Net calorific value at constant pressure on dry basis [ $\text{MJ}/\text{kg}$ ]
$q_{v,gr,d}$	Gross calorific value at constant volume on dry basis [ $\text{MJ}/\text{kg}$ ]
Q	Designation for net calorific value as received, $q_{p,net,ar}$ [ $\text{MJ}/\text{kg}$ or $\text{kWh}/\text{kg}$ or $\text{MWh}/\text{t}$ ] at constant pressure <sup>3</sup>
% in mass	weight percentage

NOTE: 1 MJ/kg equals 0.2778 kWh/kg (1 kWh/kg equals 1 MWh/t and 1 MWh/t is 3.6 MJ/kg). 1  $\text{g}/\text{cm}^3$  equals 1  $\text{kg}/\text{dm}^3$ .

---

<sup>3</sup> The designation symbols are used in the quality classes both in these guidelines and the standards. For designation of chemical properties, chemical symbols such as S (sulfur), Cl (chlorine), and N (nitrogen) are used, and the property class is added at the end of the symbol.

## Conversions of units of energy

Unit	toe	MWh	GJ	Gcal
toe	1	11.63	41.868	10
MWh	0.086	1	3.6	0.86
GJ	0.02388	0.2778	1	0.2388
Gcal	0.1	1.163	4.1868	1

For example: 1 GJ = 0.2778 MWh, 1 MWh = 3.6 GJ

1 BTU = 1.055 kJ = 0.293 MWh

1 TWh = 3,600 TJ

T = tera = 1,000,000,000,000

G = giga = 1,000,000,000

M = mega = 1,000,000

k = kilo = 1,000

m<sup>3</sup> = solid cubic metre (~ 2.5 loose m<sup>3</sup> of chips).

1 m<sup>3</sup> (solid cubic metres) ~ 2.0 MWh or 7.2 GJ

## 6. Specification and classification of wood fuels

### 6.1. Principle of the specification of wood fuels

Wood fuels are specified

1. Based on their origins and the source of their raw materials, classified in accordance with the woody biomass main class of raw material class 1 of Table 1 of the standard EN ISO 17225-1 (cf. Annex 1)
2. Based on their traded forms (Table 2) and properties (Tables 3 to 6 of this publication, Section 6.2.3)

Table 2. Classification of traded forms

Fuel name	Typical particle size	Typical production method (SFS-EN ISO 17225-1, Table 2)
Whole tree	Wood stem and branches	Cut, undelimited tree, which include also tops and branches, but not stumps and roots, if not separately mentioned
Stem	Wood stem without tops and branches	Delimited small-sized tree or stem
Logging residue	Tops and branches	Tops and branches, which are cut from stem and also un-merchantable small-sized stem wood
Stump	Stump	Stump with roots and split into few parts during pulling the stump
Chips	16 ...100 mm	Cut with sharp tools
Hogfuel	Varying	Crushing with blunt tools
Bark	Varying	Debarking residue from trees (shredded or unshredded)
Bundle, bale	Varying	Lengthwise oriented & bound logging residues or whole trees
Fuel powder	< 1 mm	Milling
Sawdust	1 ... 5 mm	Cutting with sharp tools
Shavings	1 ... 30 mm	Planing with sharp tools

Controlled blends with known energy ratios can be formed of different raw materials. This requires the determination of the weight and moisture of the fuel. The use of fuel blends is allowed in the feed-in tariff system, but the Energy Authority requires that the energy content be stated with an accuracy of 7.5% for fuel fractions in line with the classification of Statistics Finland. Chips from whole trees (21.10.20), forest residue chips (21.10.30) and hog fuel from stumps (21.10.40) are fuels entitling forest chip power plants to a feed-in tariff. If these are blended with another solid biofuel that is not subsidised, the energy content of each solid biofuel must be determined with an accuracy of 7.5%. Blends of just solid biofuels entitling a feed-in tariff, or just solid biofuels not entitling a feed-in tariff can, on a case-by-case basis, be delivered, when the net calorific value and moisture of the blend are determined, as long as the method has been described in a monitoring plan approved by the Energy Authority. It is recommended to always contact the Energy Authority regarding blends and mixtures.

See Annex 2 for examples of the product declarations and blends and mixtures of various wood fuels.

## 6.2 Specification of the classes

### 6.2.1 General principles

The wood fuels used in Finnish heat and power plants are classified based on their different characteristics in fuel specification standards parts 1 and 4.

The classification of fuel specification standard part 1 is flexible, allowing the producers and users to select a suitable class from each property class for their products and plant/application. The classification of this standard does not tie different properties to each other except for moisture (M) and calorific value (Q, as received). Some properties are normative (mandatory), some are informative (voluntary). On a case-by-case basis, some of the informative properties can be agreed to be normative. The standard is better suited for larger plants. The standard contains separate classification tables for the following wood fuels commonly used in Finland: wood chips, hog fuel, sawdust, shavings, and bark. In fuel specification standard part 1, the tables for wood chips and hog fuel are combined, and the particle size classification changes (cf. Table 4 of this publication).

The product standard, or fuel specification standard part 4, concerns wood chips suitable for non-commercial use ( $\leq 5 \text{ MW}_{\text{th}}$ , or small-scale applications that are usually  $\leq 500 \text{ kW}_{\text{th}}$  (residential, small commercial and public building applications). The properties are tied to each other forming property classes (A1, A2, B1 and B2). All properties are normative (mandatory).

### 6.2.2 Classification by the origin of the raw material

Fuel specification standard part 1 also describes a system for classifying the origin of raw materials to produce solid biofuels. The first level defines four main biomass types: woody, herbaceous, fruit and aquatic biomass, and blends and mixtures. The second level classifies the origin and sources of the biofuels, and levels three and four provide more detailed information on, for example, parts of the tree. The total of 115 fourth-level descriptions allows the detailed description of the origin of the raw material. Tables 3 and 5 describe the reporting of raw material quality for wood chips and hog fuel. Annex 1 contains a more detailed classification of wood raw materials.

### 6.2.3 Classification by properties

The classification based on different properties for wood chips and hog fuel, as presented in Table 5 of the fuel specification standard part 1, is presented in Table 3 of this publication.

Moisture is the most important factor of wood fuels in fuel trading. Moisture also affects transport costs and, at the plant, the handling of the fuels and the management of combustion and emissions.

Due to the production and storage methods of forest fuels, the internal moisture deviation of the loads can be great, which must be taken into consideration during sampling. Seasonal variations must also be taken into consideration with the delivery moistures. Measures should be taken to alleviate their impact

through, for example, correct and careful storage in accordance with the guidelines of the Forest Development Centre, Tapio.

Table 3. Classification of wood chips and hog fuel according to different properties

Normative properties (mandatory, to be stated)	
<b>Raw material</b> (SFS-EN ISO 17225-1)	From Table 1 (see Annex 1)
<b>Particle size</b> (Dimensions) – Analysis according to SFS-EN ISO 17827 (Annex 3)	See Table 4 in this publication
<b>Moisture</b> , M (% in mass as received) – Analysis according to SFS-EN ISO 18157 (Annex 4)	Classes: M 10, M 15, M 20, M 25, M 30, M 35, M 40, M 45, M 50, M 55 and M 55+ (maximum value to be stated)
<b>Ash</b> , A (% in mass dry) – Analysis according to SFS-EN ISO 18122	Classes: A 0.5, A 0.7, A 1.0, A 1.5, A 2.0, A 3.0, A 5.0, A 7.0, A 10.0 and A 10.0+ (maximum value to be stated)
Normative (mandatory only for chemically treated biomass (for raw material classes 1.2.2 (Annex 1); 1.3.2 Chemically treated used wood) and voluntary for other biomass)	
<b>Nitrogen</b> , N (% in mass dry) – Analysis according to SFS-EN ISO 16948	Classes: N 0.02, N 0.3, N 0.5, N 1.0, N 1.5, N 2.0, N 3.0 and N 3.0+ (maximum value to be stated)
<b>Chlorine</b> , Cl (% in mass dry) – Analysis according to SFS-EN ISO 16994	Classes: Cl 0.02, Cl 0.03, Cl 0.05, Cl 0.07, Cl 0.10 and Cl 0.10+ (maximum value to be stated)
<b>Sulfur</b> , S (% in mass dry) – Analysis according to SFS-EN ISO 16994	Classes: S 0.02, S 0.03, S 0.04, S 0.05, S 0.08, S 0.10, S 0.10+ (maximum value to be stated)
Informative properties (voluntary, but recommended to be stated)	
<b>Net calorific value</b> , Q (MJ/kg or kWh/kg as received) – Analysis according to SFS-EN ISO 18125	minimum value to be stated) (Annex 5 has calculation of net calorific value as received and energy density)
<b>Bulk density</b> , BD (kg/m <sup>3</sup> as received) - Analysis according to SFS-EN ISO 17828 (Annex 6)	Classes: BD 150, BD 200, BD 250, BD 300, BD 350, BD 400 and BD 450+ (minimum value to be stated)
<b>Ash smelting behaviour</b> (°C) - Analysis according to SFS-EN ISO 21404	DT (deformation temperature), HT (hemisphere temperature) and FT (flow temperature) to be stated
<b>Determination of content of heavy extraneous materials larger than 3,15 mm</b> , E <sub>m</sub> (% in mass) – Analysis according to SFS-EN ISO 19743)	Value to be stated

The delivery-specific lower limit of moisture for wood fuels can be agreed to be below 30% only when the plant receiving the wood fuels has been designed for the safe handling of fuel with the agreed moisture level.

Table 5 of fuel specification standard part 1 specifies the property classes of wood chips and hog fuels (SFS-EN ISO 17225-1, Table 5) by using particle size classification. In this standard, the grades of wood chips and hog fuels are presented in the same table. Furthermore, the net calorific value as received, or the energy density is normative (minimum value to be stated). SFS-ISO/TS 17255-9 includes classes I1, I2, I3 and I4 for hog fuel and wood chips for industrial use. All classes also include threshold values for chemical compounds (N, S, Cl, As, Cd, Cu, Pb, Hg, Ni and Zn). Class I4 can be used for chemically treated used wood (1.3.2) if plant is permitted for this kind of fuel.



Table 4. Particle size requirements for wood chips and hog fuel in accordance with standard SFS-EN ISO 17225-1. Published with the permission of SFS.

Dimensions for P16s – P63 (mm) SFS-EN ISO 17827-1				
Particle size class	Main fraction (minimum 60 % in mass), mm	Coarse fraction, % in mass (sieve aperture size or length of particle, mm)	Fines fraction (F) (< 3,15 mm), % in mass	Maximum length (L) of particles <sup>e</sup> , mm
P16s	$3,15 \text{ mm} \leq m < 16 \text{ mm}$	$\leq 6 \%, \geq 31,5 \text{ mm}$	$\leq 15 \%$	45 mm
P31s	$3,15 \text{ mm} \leq m < 31,5 \text{ mm}$	$\leq 6 \%, \geq 45 \text{ mm}$	$\leq 10 \%$	120 mm
P45s	$3,15 \text{ mm} \leq m < 45 \text{ mm}$	$\leq 10 \%, \geq 63 \text{ mm}$	$\leq 10 \%$	200 mm
P16	$3,15 \text{ mm} \leq m < 16 \text{ mm}$	$\leq 6 \%, \geq 31,5 \text{ mm}$	to be stated from F-classes below	value to be stated
P31	$3,15 \text{ mm} \leq m < 31,5 \text{ mm}$	$\leq 6 \%, \geq 45 \text{ mm}$		
P45	$3,15 \text{ mm} \leq m < 45 \text{ mm}$	$\leq 10 \%, \geq 63 \text{ mm}$		
P63	$3,15 \text{ mm} \leq m < 63 \text{ mm}$	$\leq 10 \%, \geq 100 \text{ mm}$		
Dimensions for PL10 – PL30+ (mm) SFS-EN ISO 17827-1				
Particle size class	Particle size fractions (% in mass)	Mass of long particles ( $100 \text{ mm} \leq m \leq$ maximum length of particle), % in mass	Fines fraction (F) (< 3,15 mm), % in mass	Maximum length (L) of particle, mm
PL 10 PL 20 PL 30 PL 30+	all screening results to be stated	$0 \% \leq m \leq 10 \%$ $10 \% < m \leq 20 \%$ $20 \% < m \leq 30 \%$ $L > 30 \%$ (value to be stated)	to be stated from F-classes below	value to be stated
Fines fraction, F (< 3,15 mm % in mass) SFS-EN ISO 17827-1				
F02	$\leq 2 \%$			
F05	$\leq 5 \%$			
F10	$\leq 10 \%$			
F15	$\leq 15 \%$			
F20	$\leq 20 \%$			
F25	$\leq 25 \%$			
F30	$\leq 30 \%$			
F30+	$> 30 \%$ (maximum value to be stated)			

s refers to wood chips that are suitable for residential use and m is mass staying on the mentioned sieve size.

Figure 1 of Annex 3 presents examples of the different fractions of particles size for grades P45, P45s and P63. The grade is named based on the main fraction, and the main fraction must make up at least 60% of the weight of the fuel. The class of the fines is also separately stated, for example F25.

The fuel specification standard part 4 only allows classes F10 (for classes P31s and P45) and F15 (for class P16s) for fines. Only the P code is then included in the grade.

Wood chips for non-commercial use can be classified into grades A1, A2 or B1, B2 in accordance with fuel specification standard part 4. The classification is presented in Table 5. The table rows contain the classified property together with the grade. The grades and their requirements are listed in the columns.

Table 5. Fuel specification of wood chips intended for small plants according to different properties.

Normative properties	Grade and values	
<b>Raw material</b> (SFS-EN ISO 17225-1) 1.1.1 Whole trees without roots (excluding class 1.1.1.3 Short rotation coppice), 1.1.3 Stem wood, 1.1.4. Logging residues	A1, A2	
1.2.1 Chemically untreated by-product or residue from wood processing industry	A1, A2, B1	
1.1 Forest wood, plantation wood and other virgin wood (excluding 1.1.5 stumps/root and 1.1.6 bark)	B1	
1.2 By-products and residues from wood processing industry (can include chemically treated wood e.g. glued, laminated, painted wood) <sup>1</sup> , 1.3.1 Chemically untreated used wood <sup>1</sup>	B2	
<b>Particle size</b> (Dimensions) – Analysis according to SFS-EN ISO 17827-1 Specification according to SFS-EN ISO 17225-4 Table 1 or Table 4 in this publication	A1, A2,	Select Ps or P classes from Table 4
	B1, B2:	Select Ps or P classes from Table 4
<b>Moisture</b> , M (% in mass as received) - Analysis according to SFS-EN ISO 18134-2	A1:	≤ 25
	A2:	> 25 and ≤ 55
	B1:	≤ 35, values < 10 % in mass to be stated
	B2:	> 35 and ≤ 55 value range to be stated
<b>Ash</b> , A (% in mass as received) – Analysis according to SFS-EN ISO 18122	A1:	A 1.0
	A2:	A 1.5
	B1, B2:	A 3.0
Informative properties		
<b>Net calorific value</b> , Q (MJ/kg or kWh/kg as received) - Analysis according to SFS-EN ISO 18125	A1, A2:	minimum value to be stated
	A2:	Q 11.0 or Q 3.1
	B1, B2:	minimum value to be stated
<b>Bulk density</b> , BD (kg/m <sup>3</sup> as received) - Analysis according to SFS-EN ISO 17828	A1:	BD 150, BD 200, BD 250
	A2:	BD 150, BD 200, BD 250, BD 300
	B1, B2:	minimum value to be stated
Normative properties only for classes B1 and B2		
<b>Nitrogen</b> , N (% in mass dry) - Analysis according to SFS-EN ISO 16948	B1, B2:	N 1.0
<b>Sulphur</b> , S (% in mass dry) - Analysis according to SFS-EN ISO 16994	B1, B2:	S 0.1
<b>Chlorine</b> , Cl (% in mass dry) – Analysis according to SFS-EN ISO 16994	B1, B2:	Cl 0.05
<b>Major elements</b> (mg/kg dry) – Analysis according to SFS-EN ISO 16967 Arsenic (As), Cadmium (Cd), Chromium (Cr), Copper (Cu), Lead (Pb), Mercury (Hg), Nickel (Ni), Zinc (Zn)	B1:	not needed
	B2:	As 1, Cd 1, Cr 10, Cu 10, Pb 10, Hg 0,1, Ni 10 and Zn 100

<sup>1</sup> may not contain more halogenated organic compounds or heavy metals than virgin wood (see Table 10 in Alakangas, E. 2014, Guidelines for used wood the classification, VTT-M-01931-14). Demolition wood is not covered by the standard.

<sup>2</sup> Wood chips made from short rotation coppice, which are fertilised by sludges, are classified in class B1.

The delivery-specific lower limit of moisture for wood fuels can be agreed to be below 30% only when the plant receiving the wood fuels has been designed for the safe handling of fuel with the agreed moisture level.

Fuel specification standard part 1 also presents grades for the most common by-products of the forest industry (sawdust, shavings, and bark). The classification is presented in Table 6.

Table 6. Fuel specification of by-products and residues from the forest industry based on their different properties

Normative properties	Sawdust, shavings	Bark
<b>Raw material</b> (SFS-EN ISO 17225-1)	1.2.1.3 tai 1.2.1.4 1.2.2.1	1.2.1.5
<b>Particle size</b> (Dimensions) - Analysis according to SFS-EN ISO 17827-1 (Annex 3)	no requirements	Nominal top size P 16, P 45, P 63, P 100 and P 200 and P 300
<b>Moisture, M</b> (% in mass as received) - Analysis according to SFS-EN ISO 18134	<i>Sawdust:</i> M 10, M 15, M 20, M 25, M 30, M 35, M 45, M 50, M 55, M 60, M 65 and M 65+ <sup>1)</sup> <i>Shavings:</i> M 10, M 15, M 20, M 30 and M 30+ <sup>1)</sup>	<i>Bark</i> M 20, M 25, M 30, M 35, M 40, M 45, M 50, M 55, M 60, M 65 and M 65+ <sup>1)</sup>
<b>Ash, A</b> (% in mass dry) - Analysis according to SFS-EN ISO 18122	A 0.5, A 0.7, A 1.0, A 1.5, A 2.0, A 3.0, A 5.0, A 7.0, A 10.0 and A 10.0+ <sup>1)</sup>	A 1.0, A 1.5, A 2.0, A 3.0, A 5.0, A 7.0, A 10.0 and A 10.0+ <sup>1)</sup>
<b>Scredding</b> - According to standard SFS-EN ISO 17225-1 Table 9	not needed	shredded or not shredded
<b>Net calorific value, Q</b> (MJ/kg as received) or <b>energy density, E</b> (MWh/loose-m <sup>3</sup> ) - Analysis according to SFS-EN ISO 18125	Minimum value to be stated	
<b>Normative properties</b> (only normative 1.2.2.1 and informative for other biomass)		
<b>Nitrogen, N</b> (% in mass dry) - Analysis according to EN ISO 16948	N 0.2, N 0.3, N 0.5, N 1.0, N 2.0, N 3.0 and N 3.0+ <sup>2)</sup>	N 0.5, N 1.0, N 2.0, N 3.0 and N 3.0+ <sup>2)</sup>
<b>Chlorine, Cl</b> (% in mass dry) - Analysis according to EN ISO 16994	Cl 0.01, Cl 0.02, Cl 0.03, Cl 0.07, Cl 0.10 and Cl 0.10+ <sup>2)</sup>	Cl 0.02, Cl 0.03, Cl 0.07, Cl 0.10 and Cl 0.10+ <sup>2)</sup>
<b>Informative properties</b> (voluntary)		
<b>Bulk density, BD</b> (kg/m <sup>3</sup> as received) - Analysis according to EN ISO 17828	BD 100, BD 150, BD 200, BD 250, BD 300, BD 350 and BD 400+ <sup>1)</sup>	BD 250, BD 300, BD 350, BD 400 and BD 450
<b>Ash smelting behaviour</b> (°C) - Analysis according to SFS-EN ISO 21404	DT (deformation temperature), HT (hemisphere temperature) and FT (flow temperature) to be stated	

<sup>1)</sup> The maximum value to be stated for grades ending in the plus character (+).

<sup>2)</sup> Nitrogen and chlorine are normative (mandatory) only for chemically treated wood (class 1.2.2), including painted or varnished wood and particle board or plywood residues, and informative for other wood fuels. In the fuel specification standard part 1, nitrogen and chlorine must also be stated for chemically treated wood. Additionally, Table 10 of the Alakangas, E. 2014 (Guidelines for used wood classification VTT-M-01931-14) presents additional requirements for the determination of chemical properties. Requirements are also presented in English in Table II (Alakangas, E. & al. 2015).

In order to improve the general environmental performance of combustion and/or gasification plants ( $\geq 50$  MW) and to reduce emissions to air, Best available technique (BAT) is to include the following elements in the quality assurance/quality control programmes for all the fuels used, as part of the environmental management system:

- i. Initial full characterisation of the fuel used including at least the parameters listed below and in accordance with EN standards. ISO, national or other international standards may be used provided they ensure the provision of data of an equivalent scientific quality;
- ii. Regular testing of the fuel quality to check that it is consistent with the initial characterisation and according to the plant design specifications. The frequency of testing and the parameters chosen from the table below are based on the variability of the fuel and an assessment of the relevance of pollutant releases (e.g., concentration in fuel, flue-gas treatment employed);
- iii. Subsequent adjustment of the plant settings as and when needed and practicable (e.g. integration of the fuel characterisation and control in the advanced control system).

Description Initial characterisation and regular testing of the fuel can be performed by the operator and/or the fuel supplier. If performed by the supplier, the full results are provided to the operator in the form of a product (fuel) supplier specification and/or guarantee (e.g. in fuel declaration).

Publication Alakangas et. al. 2016 can be used for initial fuel characterization.

*Table 7. Fuel(s) Substances/Parameters subject to characterization (LCP BREF)*

Fuel	Properties
<b>Biomass/peat</b>	<ul style="list-style-type: none"> <li>– Net calorific value dry basis (Net calorific value as received can be calculated according to formula presented in Annex 5)</li> <li>– Moisture (analysis method described in Annex 4)</li> </ul>
	<ul style="list-style-type: none"> <li>– Ash</li> <li>– C, Cl, F, N, S, K, Na</li> <li>– Metals and metalloids (As, Cd, Cr, Cu, Hg, Pb, Zn)</li> </ul>

## 7. Determining the quality grade

### 7.1 General

The standards applied to the determination of the different properties of wood fuels are listed in Table 1. The fuel specification of wood fuels used in Finland (wood chips, hog fuel, sawdust, shavings, and bark) is presented in Section 6.2. Different trade forms are used in forest energy deliveries in particular; their definitions can be found in Section 4.1 and Table 2. Sub-classes of the general designation 'forest chips' in use include forest residue chips (21.10.30), chips from whole tree, stemwood (21.20.20), and hog fuel from stumps (21.10.40).

Limit values have been specified for each property on which the wood fuel specification is based, used to specify the desired grade. Wood fuel is specified by stating the desired quality grade separately for each property in the fuel specification standard part 1. With regard to the examined property, a batch of fuel (e.g. a delivery lot or a fuel load) is of a certain quality grade, when the average numerical value of the property in question is between the specified limit values. For example, a delivery lot with a quality grade of M35 is comprised of three loads, the moisture contents of which are 34.0 % in mass, 35.3 % in mass and 33.5 % in mass. The average moisture is then 34.3 % in mass, and the lot meets the requirements of grade M35.

In continuous deliveries, it is recommended to monitor the moisture values for each agreed delivery lot or sub-lot. Other agreed monitored properties, most importantly, net calorific value and ash and chlorine contents, can be determined. An agreement can be made to monitor these properties monthly unless there is a specific reason for more frequent monitoring.

### 7.2 Moisture (M)

Select the maximum value or value range for moisture content in the delivery lot from the wood fuel class specific quality grade table.

Wood fuels must be as homogeneous as possible, and particular attention must be paid to moisture variations. When agreeing on the moisture content of a delivery lot, any seasonal variations for different wood fuels must also be taken into consideration.

See Annex 4 for a moisture determination method that complies with the moisture determination standard SFS-EN ISO 18134-2.

When determining moisture content, other moisture content measurement methods (such as rapid moisture meters) can also be used when separately agreed, if their equivalence with the standard methods can be proven. The rapid moisture meters must be calibrated and checked separately for each fuel in accordance with the moisture determination standards.

X-ray scanning method can be used for continuous analysis moisture content of the fuel. The radiation is generated from an electronic radiation source. During the measurement, radiation is directed through the fuel flow and the permeating radiation is measured using a sensor with large resolution. The measurement data provided by the sensor is used to form X-ray images, which in turn are analysed in real time to measure moisture and concentrations of foreign material, in addition to identifying e.g., foreign objects with a greater density than the fuel (metals, stones etc.). The total fuel flow is measured. Measurement is also not disrupted by foreign substances and it can also be used to measure frozen fuel. Tens of fuel types have been pre-calibrated into the system. Since measuring conditions are always different in each installation, calibration measurements are conducted during system implementation. New fuel types may be added to the system later. The quality of measurements is verified through regular reference measurements with a standard method (SFS-EN ISO 18134-2).

### 7.3 Net calorific value as received ( $q_{p,net,ar}$ )

The net calorific value as received, or the net calorific value of wood fuel  $q_{p,net,ar}$  on a wet basis is calculated according to formula 1 based on the net calorific value on a dry basis ( $q_{p,net,d}$ ).

$$q_{p,net,ar} = q_{p,net,d} \times \left( \frac{100 - M_{ar}}{100} \right) - 0,02443 \times M_{ar} \quad (1)$$

where

$q_{p,net,ar}$  is the net calorific value (at constant pressure) as received (MJ/kg);

$q_{p,net,d}$  is the net calorific value (at constant pressure) on dry basis (MJ/kg);

$M_{ar}$  is the moisture as received [% in mass]; and

0.02443 is the correction factor for the enthalpy of vaporisation (at constant pressure) for water (moisture) at a temperature of 25 °C [MJ/kg per 1 % in mass of moisture].

In fuel specification, the symbol Q is used for the net calorific value as received. The result is given rounded to the nearest 0.01 MJ/kg. If the calorific value is converted into kWh/kg, the conversion should not be done until after the calculation. See Annex 5 for an example of the calculation of the calorific value.

## 7.4 Energy density as received ( $E_{ar}$ )

The delivery lot's energy density as received ( $E_{ar}$ ) is calculated based on the net calorific value as received and the bulk density as received using Formula 2.

$$E_{ar} = \frac{1}{3600} \times q_{p,net,ar} \times BD_{ar} \quad (2)$$

where

$E_{ar}$  is the solid biofuel's energy density as received (MWh/m<sup>3</sup> loose volume);

$q_{p,net,ar}$  is the net calorific value as received (MJ/kg);

$BD_{ar}$  is the bulk density, or the volume weight of the wood fuel as received (kg/m<sup>3</sup> loose volume); and

$\frac{1}{3600}$  is the conversion factor for the units of energy (from MJ to MWh).

The result is given rounded to the nearest 0.01 MWh/m<sup>3</sup> loose volume.

## 7.5 Delivered energy (W)

The delivered energy W (in MWh) is calculated using formula 3.

$$W = \frac{Q}{3,6} \times m \quad (3)$$

where

$\frac{Q}{3,6}$  is the conversion of the net calorific value as received (MJ/kg) to MWh/t;

m is the mass/weight of the delivered fuel (tonnes)

For small lots and random use, the procedure described above may be too cumbersome; for example, smaller plants may not always have vehicle scales available. In such cases, the energy of a fuel delivery lot can be determined as follows:

- measure the volume of the delivered fuel lot in accordance with the Finnish Timber Measurement Act (414/2013);
- determine the bulk density of the fuel (BD) (Annex 6); and
- based on sampling, determine the moisture (M) and net calorific value (Q) of the fuel, or determine the moisture but use a commonly agreed, typical wood fuel class specific net calorific value on dry basis (Alakangas et. al. 2016).

Other determination methods of delivered energy and their application are separately agreed on a case-by-case basis. The energy of a delivered fuel lot can be determined at small plants with the help of the produced energy and the efficiency of the boiler (SFS-EN 12952-15:en).

## 7.6 Bulk density (BD)

The bulk density as received (BD, kg/m<sup>3</sup>) is obtained by dividing the weighed weight of the load by its volume. The weighing and volume measurement are carried out in the manner agreed by the supplier and user in the delivery agreement.

The bulk density of fuel can also be determined for wood chips and hog fuel by using a 50-litre container in accordance with the bulk density determination standard. The method is described in Annex 6.

## 7.7 Particle size distribution (P)

The particle size distribution for wood fuels is determined in accordance with the particle size determination standard part 1. The determination of particle size is described in Annex 3. Plant-specific combustion and handling systems place limits on both the amount of fines and the maximum dimensions and number of largest particles. The maximum length are determined for the coarse fraction only (particles staying on 63 mm sieve apparatus size).

## 7.8 Other properties

Ash content and ash melting behaviour are properties that are important with regard to combustion, particularly for stumps and forest residue chips. Ash content must always be determined during the determination of the calorific value of stumps and forest residue, unless the parties have agreed otherwise.

Other properties can also be determined, e.g. the chlorine, carbon and hydrogen content, and the concentrations of major and minor elements, that specifically apply to the delivered wood fuel and that might be needed. The chlorine (Cl), sodium (Na) and potassium (K) contents influence the ash melting behaviour as well as increase the fouling and corrosion risk of the boiler. For this reason, these should be determined at the beginning of the deliveries and from large fuel lots. With high-pressure steam boilers, it is recommended to determine these concentrations at least quarterly from each type of fuel. Chlorine content alone is not enough to indicate the risk level of the examined fuel with regard to fouling and corrosion of the superheaters. The ratio of sulfur (protective factor) and chlorine (fouling and corrosive) in the main or secondary fuel is a better indicator. Professional help should be sought for interpreting the results, as there is no specific chlorine level that would allow one to assume that there will be no problems with the boiler. The agglomeration of the bed material in fluidised bed boilers has been found to be mainly caused by the amount of potassium (K), calcium (Ca) and silicon (Si) in the ash, and the bed material used. Silicates in the ash can react with the potassium in the ash, forming slag (glass like material) that melts at bed temperatures and may sinter into the bed sand if it is not replaced often enough.

The informative (voluntary) properties mentioned in the standards can be agreed to be normative on a case-by-case basis.



If the producer or user/buyer measures the fuel properties of delivered fuel, this information should be available to all parties upon a reasonable request.

## 8. Quality assurance of wood fuels

Quality assurance aims to establish trust in material quality, permanently meeting the agreed customer requirements that are usually stipulated in the delivery agreement or the product declaration provided by the supplier. See Annex 2 for sample product declarations. This shows that the agreed quality requirements are met, which does not necessarily mean that the fuel is of a high quality. In addition to the fuel quality, the agreed quality requirements cover the quality of the operations of the company delivering fuel or service (e.g. schedules, logistics and proper documentation). Quality assurance covers the entire delivery chain. Quality assurance standard parts 1 and 4 and the ISO 9000 system are applied to quality assurance.

Quality assurance enables the producers and suppliers to create a fuel quality system. Its purpose is to ensure that

- the delivery chain is traceable;
- the requirements affecting fuel quality are monitored; and
- the end-user/buyer can trust the fuel quality.

Documentation is an important part of quality assurance.

The appropriate production, storage and transport methods have an extremely large impact on the quality of the delivered wood fuel. They can also ensure that the fuel is stored in correct conditions. All operators in the fuel delivery chain must avoid taking actions that would degrade fuel quality (including the user/buyer with regard to final storage).

The operators participating in the transport, handling and storage of wood fuels after production must document their activities.

Appropriate methods must be used in the production, storage and distribution of wood fuels, and the recommendations of Tapio, on the harvesting and growing of energy wood. Impurities and over-sized particles increase in the amount of fines and quality degradation in the fuel lot must be avoided. Examples of impurities are stones, soil, pieces of metal, plastics, ice and snow. The absorption of moisture into the wood fuel may degrade its quality. Heavy extraneous materials (> 3,15 mm) can be analysed according to SFS-EN ISO 19743).

Factors to be particularly taken into consideration:

- weather and climate conditions (e.g. risk of rain or snow) and need for protection during storage;
- storage conditions (e.g. air circulation, moisture absorption, getting wet through the bottom) and the estimated duration of storage;
- storage structure (e.g. prevention of increase in the amount of fines and the rise of the fuel temperature);
- loading and unloading conditions (e.g. impurities, over-sized particles and increase in the amount of fines, smouldering or burning wood fuel);
- the impact of transport on the fuel (e.g. dust formation, particularly adhered dust or fines, road salt);
- uniformity of quality (taking technical and financial limitations into consideration, the quality of the delivered wood fuel must be as homogenous as possible; particular attention must be paid to the moisture differences between individual consecutive loads that must be as small as possible);
- the aim must be to have deliveries with moisture contents that are as homogenous as possible;
- cleanness of all tools and equipment and their suitability for the work stage in question; and
- the competence of the staff throughout the entire delivery chain.

Raw materials or fuels identified as non-conforming at any stage of the production process must be separated and removed from the production chain. If deviations of the defined requirements are found during the visual inspection or testing of the raw material or the intermediate/final product, the deviating lot must be rejected.

Examples of factors indicating product deviations are excessive numbers of over-sized particles, impurities or fines. A lot can be made to meet the quality requirements by, for example, screening it again. In some cases, the non-conforming product can be used for a different purpose, or it can be returned to the delivery chain as raw material.

Smouldering or burning wood fuel must not be delivered to the plants. If smouldering fuel is detected during unloading, unloading must be interrupted and it must be ensured that smouldering fuel does not get into the plant's processing system.

## 9. Sampling and the preparation of samples

### 9.1 General on sampling

Sampling refers to extracting and separating a specific batch suitable for analysis from a larger volume in such a manner that the sample and the original lot of materials are identical with regard to the desired properties. In fact, representative sampling means the reduction of both systematic and random errors.

The simplified principles of good sampling and sample processing are:

- the sampling location must be as close to the receiving location of the fuel (change of ownership);

- samples must be taken from freely moving fuel, for example from a falling fuel stream;
- the entire fuel stream or the majority of it must be subjected to sampling;
- several smaller increments are taken from the fuel stream;
- continuous sampling from a partial stream must be avoided; and
- the preparation and dividing of samples must not change the analysed properties.

## 9.2 Sampling scheme

The basic principle of good sampling is to obtain a representative sample of the entire fuel lot being tested. Every particle in the lot or sub-lot that the sample represents should have an equal probability of being selected as part of the sample. The purpose of sample processing is to reduce the sample while maintaining its representativeness. In order to ensure this, a sampling scheme is required; it is recommended to include a sampling and processing diagram to the scheme.

We recommend preparing a detailed sampling scheme for each plant that is approved by both the fuel supplier and the heat or power plant (buyer of the fuel) when making the contract, and which can form a part of the delivery agreement of the fuel contract in the future. Emissions trade also requires a plant-specific sampling scheme. When the scheme is being prepared, plant-specific issues to be taken into consideration include: fuel delivery logistics, vehicle unloading methods, and the requirements and limitations placed by the plant's reception and handling system on the best possible and reliable sampling and handling method. Safety issues must also be taken into consideration. Summarised and simple sampling instructions are also prepared based on the scheme. The sample collectors, who are usually the vehicle drivers in Finland, will follow these instructions during unloading.

With each heat or power plant (fuel buyer), the following things are agreed in the scheme:

- the sampling location and method best suitable for reception;
- the sampling devices and equipment used;
- the number and volumes of increments;
- the preparation, storage and labelling of samples, the documentation of sampling; and
- unusual occasions' management.

These quality guidelines provide standard-compliant general instructions for both sampling and the preparation of samples, based on which plant-specific plans and instructions can be prepared.

## 9.3 Sampling location

In fuel deliveries, the primary sampling location is the fuel's receiving station. In practice, this is often the reception station, where increments are taken during unloading from the fuel stream falling from the load, or immediately afterwards from the receiving hopper, the conveyor leaving the reception, or from the fuel stream falling off the conveyor. The sampling location should be chosen so that a representative sample of the fuel lot can be obtained most surely and at a reasonable expense. A representative sample can be most reliably taken from a moving, falling fuel stream.

According to the current experience, the recommended order for the incremental sampling of fuels is as follows:

- moving, continuous fuel stream, primarily at a reception station, but also during at the loading or load transfer stages, for example at terminals;
- mechanically directly from the load, if samplers drilling through the load or other mechanical sampling devices are developed;
- at the reception station during unloading or immediately afterwards, either from the receiving hopper or the fuel storage yard;
- at the loading stage from the bucket of the loader or the working face of the stockpile; and
- collecting samples from large wood fuel stockpiles or stacks for commercial purposes is not recommended, because obtaining a representative sample is uncertain and requires an undue amount of work.

## 9.4 Sampling procedure

### 9.4.1 General

The sampling stage is where the most inaccuracies originate during analysis of results. For this reason, particular attention must be paid to sampling, and it must be done in a systematic and careful manner. The best precision can be achieved when sampling is mechanical, which is possible when collecting samples from a continuous stream of fuel.

Due to the non-homogeneous nature of wood fuels, it is often difficult to collect increments in a manner that meets the principle of good sampling, according to which each individual particle should have an equal probability of being selected for the final sample. This is the case particularly when collecting samples from stationary fuel that has often segregated according to particle size, such as stockpiles, silos, receiving hoppers, or loads. Collecting increments is easier and more reliable when the fuel is moving, for example directly from a conveyor or a fuel stream falling off the conveyor, and during the loading and unloading of the fuel. In summary, samples should be collected from a moving, preferably falling fuel stream, if this can at all be arranged.

### 9.4.2 Mechanical sampling

According to the basic principle of mechanical sampling, the increments are collected in such a manner, that the fuel stream's entire cross section is represented in the sample in accordance with the principle of averages. This is easiest to implement by collecting the samples either directly from the conveyor belt, cutting a part of the entire fuel stream or the fuel stream falling off at the end of the conveyor into the sample (Figure 1). This is usually done by the sampling container moving at a constant speed across the entire fuel stream, cutting the sample from the entire fuel stream. There are several alternative methods for the mechanical sampler's movement solutions. In both cases, the sampler's aperture must be at least 2.5 times the nominal top size of the material (the round apertures of the sieve where at least 95% by mass of the fuel passes). The sampling container must be large enough. The fill rate of the sampling container should be designed to  $2/3$  (around 67%) of the volume of the entire container in accordance with the standard.

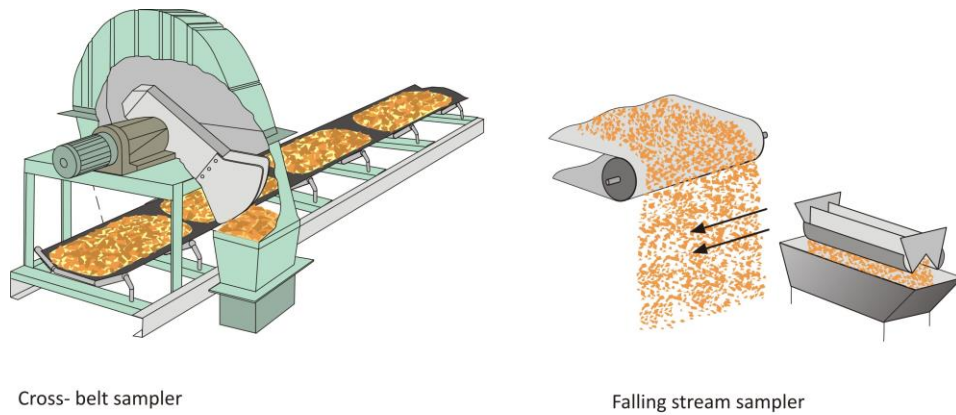


Figure 1. A cross-belt cutter on the left, and a falling stream sampler on the right. Drawing: VTT/Eija Alakangas.

Mechanical sampling can also be implemented from scraper and screw conveyors. Increments can be collected from such intermittent fuel streams by opening the bottom of the conveyor from its entire width so that the entire intermittent lot of fuel is collected into the sample, for example the fuel lot between scraper blades.

When selecting the sampling location on the conveyor line, one must ensure that the fuels from different loads and different suppliers remain separate at the sampling location. Similarly, the sampling interval must be chosen according to the unloading and conveyor capacity so that the planned number of increments per load can be collected and representatively spread over the length of the entire load.

Increments can also be collected at the reception station directly from the fuel stream falling off the load using screw samplers. In mechanical sampling, the increment volumes are large, so sample crushing, mixing and division equipment have also usually been designed for the automated systems. They produce a relatively small load-specific sample into a supplier-specific collection bin. After mixing and division, these combined samples provide a date-specific laboratory sample for analysis.

Because the plant receives loads that are from different suppliers and contain different fuel grades, it must be ensured that the sampler and sample preparation equipment used are always cleaned after a load-specific sampling sequence. Similarly, it must be guaranteed that the entire sample lot collected (also including the fines and the largest particles) are included in the sample.

When mechanical sampling and preparing equipment are used, their reliability must be tested, mainly in order to detect and eliminate any systematic errors. Additionally, the different parties must approve their deployment for the purpose of sampling on which the fuel pricing is based.

### 9.4.3 Manual sampling

At most plants, the quality and pricing of fuel are based on manual sampling. The increments are most commonly taken during unloading either from the fuel stream falling from a rear dump vehicle or immediately after the unloading, for example from a load-specific fuel pile, receiving hopper or the fuel storage yard.

Manual sampling can be implemented from conveyor systems using the same principles as the mechanical sampling methods described above. When implemented correctly, however, they are cumbersome for continuous use, because when collecting samples directly from a belt conveyor, for instance, the conveyor must be stopped for the duration of sampling.

A sampling scoop with a long handle (Figure 2) must be used in manual sampling. The diameter of its aperture in both directions must be at least 2.5 times the nominal top size of the fuel.



*Figure 2. Pictured (on the left) a shovel-type sampler for collecting samples from a fuel stockpile and on the right, a three-litre sampling scoop for collecting samples from a moving stream. Photos: Haklog ky and Ismo Tiihonen.*

When samples are collected directly from a fuel stream falling from the load, the sampling interval is determined so that a sufficient number of increments per load can be collected evenly from different parts of the load. Samples should also be collected from different parts of the fuel stream in the lateral direction as well. Collecting samples from, for example, the very first particles from a rear dump vehicle and the last scraps should be avoided. Safety must also be taken into consideration during sampling with regard to the fuel stream falling from the vehicle. We recommend arranging the sampling from "behind a glass" from a space that is as clean as possible using a sampling scoop with a long handle. Indeed, this has been successfully implemented at many plants.

When collecting samples from a receiving hopper, for example after the unloading of a side dump vehicle, the sample collector must walk around the entire hopper and collect samples from different parts of the

hopper while taking safety issues into consideration, so that the sampling is done evenly from different parts of the entire load.

The fuel load must often be unloaded to the fuel storage field. Samples can then be collected from the fuel stream falling from a rear dump vehicle in the manner described above. However, it is not always possible to collect increments from a falling stream, and the samples must be collected after unloading from a load-specific pile. Then, too, a sampling scoop must be used, and the samples must be collected from different parts of the pile around it in such a manner that the sampling is done as evenly as possible from different parts of the dumped load. The fuel has segregated during dumping almost without exception, with the coarsest particles at the bottom of the pile and the finest matter in the middle and top of the pile. For this reason, samples must also be taken at regular intervals in the vertical direction of the pile. Collecting samples from the surface of the pile must be avoided; the samples must be dug from beneath the surface layer with the sampling scoop. Collecting samples from the absolute bottom and edges of the pile should also be avoided (Figure 3).

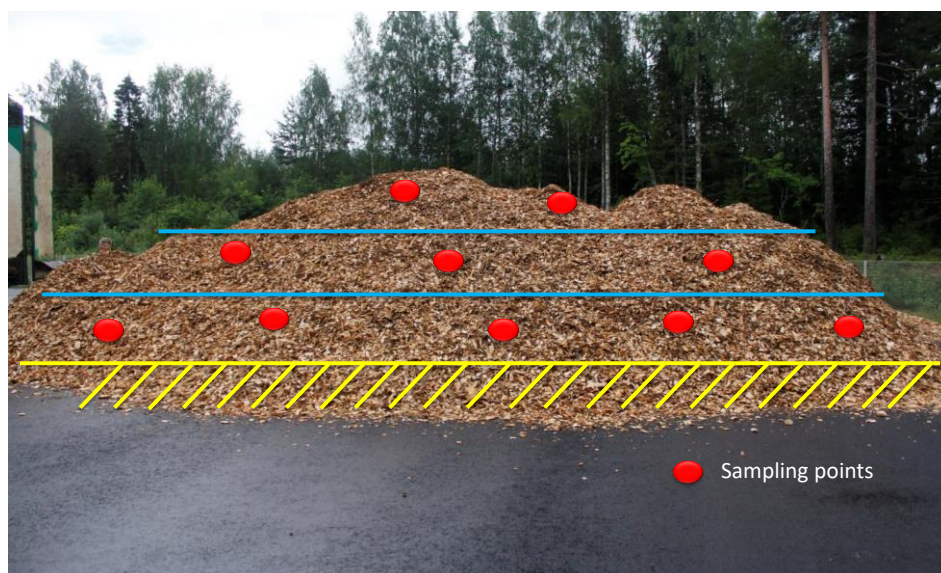


Figure 3. The location of sampling points in a small pile of fuel. Photo: Haklog Ky

In manual sampling, the purpose is to be as systematic as possible when collecting load-specific increments. The main principle is that the samples represent the entire load uniformly with no kind of segregation or selection taking place during the sampling. The sample collector must not make a selection with regard to, for example, particle size; instead, even the largest particles and any impurities collected must be included into the load-specific combined sample.

### 9.5 The number and volume of increments

The most important factors affecting the number of increments are the actual dispersion of a certain property, such as moisture, in the lot (load) being sampled, the precision requirement, and the number of loads belonging to the delivery lot (Annex 8). As the moisture dispersion increases, the precision





Examples:

sawdust	0.5 litres
forest chips	3 litres
hog fuel, wood chips from tree tops	5 litres
bark	5 litres

In many cases, as many as tens of litres of material, are collected as samples per load, when mechanical sampling is used. After the sample has been divided, the excess sample material is returned to the feed line. The size of the final sample is close to the size of an increment collected manually. The sample must be properly divided to ensure that a representative sample is obtained from each load. Separate testing approved by both the fuel supplier and user/buyer is recommended in order to ensure that the mechanical sampling operates reliable and that representative samples are obtained.

## 9.6 Sample preparation and processing

### 9.6.1 General

The sampling standard describes both methods that can be used to reduce combined samples into laboratory and analysis samples, and equipment and methods suitable for mixing and dividing samples.

Certain basic principles must be followed in the reliable preparation of samples:

- the basic principle of division is that the composition of the sample must not change from the original during the different processing steps;
- a careful mixing of the samples improves the reliability of division;
- when the particle size of wood fuels is being reduced (by crushing or grinding), no moisture changes or loss of fines may occur;
- the heating and drying of the sample must be avoided during its processing and storage; and
- the sampling and sample processing equipment and methods used for commercial determination of quality must always be tested in a jointly agreed manner.

### 9.6.2 Combined samples

Combined samples are formed of the delivered fuels for the determination of their properties, primary for the purpose of determining the price, but also for emissions trading and other separately defined purposes.

Combined samples are formed for the determination of both fuel moisture and the properties of the dry matter of the fuel (ash, calorific value, etc.). The combined samples are formed supplier-specifically and, if necessary, fuel type or delivery location specifically.

Combined samples are always formed of a certain time period. The length of such period is usually

- one day, or a delivery lot for moisture. With large deliveries, e.g. over 2 000 m<sup>3</sup> of loose or stacked volume, it is recommended to form sub-lot-specific combined samples.
- no more than one month for dry matter properties (such as calorific value and ash content)

According to the sampling standard, any of the following methods can be selected in the quality determination of solid biofuels when forming combined samples and laboratory samples

1. All delivery lot specific increments are put directly into a single container forming a combined sample that is sent to a laboratory, where a laboratory sample is prepared from it.
2. The increments are mixed together, forming a combined sample from which a laboratory sample is prepared after mixing and division.
3. Each increment is put into a separate container or bag and sent to a laboratory. The laboratory combines the samples forming a laboratory sample.

With large deliveries, supplier-specific and, if necessary, fuel type-specific samples are collected in a delivery-lot-specific manner into a large combined sample container, from which a sample is obtained for moisture determination once a day after mixing and division. With smaller deliveries, the load-specific samples can be collected into their own plastic bags or containers that are then delivered to moisture determination. With wood fuels, the large volumes of the increments are a problem, which means that the load-specific combined sample must be divided to make it smaller before delivery to a laboratory.

The combined sample for determining the dry matter properties is usually formed of the dried part of each moisture determination sample by weighing an amount of dried sample proportional to the dry matter tonnage represented by the sample in question. A corresponding sample can also be extracted from wet fuel lots proportionally to the size of the delivery lot represented by the sample.

The combined samples must be stored carefully throughout the entire duration of the collection in lidded, airtight containers in a space that is as cool as possible. One must also ensure that the moisture of the combined sample collected for moisture determination does not change during storage.

### **9.6.3 Sample preparation**


Annex 7 presents the different sample size reduction steps and the sample amounts at different process stages in accordance with the sampling standard.

The combined sample is divided into a laboratory sample of the required or desired size; with solid fuels, its volume is at least two litres. The minimum volume is determined by the moisture determination in accordance with the moisture standard that requires a sample size of at least 300 g of wet material. If there is also a wish to determine other fuel properties, a larger sample is required. If the calorific value, ash content and moisture are determined at the same time, around 500 g of material is needed for the sample. Table 8 presents required sample amounts for different analyses.

Table 8. Sample amounts for typical analyses

Analysis	Amount of sample
Basic analysis (calorific value; Q, Ash; A, Sulfur S, Carbon; C, Hydrogen; H and Nitrogen; N)	About 2 litres (can be analysed also from moisture content analysis)
Moisture; M	at least 300 g about 2 litres
Bulk density; BD	about 70 litres, when analysis is carried out with 50 litres container
Particle size; P	at least 8 litres

Large combined samples can be mixed and divided using various quartering and pile methods, the descriptions of which are found in the sampling standard. Before the combined sample is divided, it is essential to mix it well. After mixing, the combined sample can be divided using suitable equipment; see Figure 4 for examples of standard-compliant dividing equipment. As the particle size of wood fuels increases, the dimensioning of a container type divider must take into consideration that the container aperture must be large enough for the divider to operate reliably, or 2.5 times the nominal top size. Particularly when dividing wet fuels, the use of such mechanical dividers requires a significant amount of work and great care in cleaning and drying the device before processing the next sample.

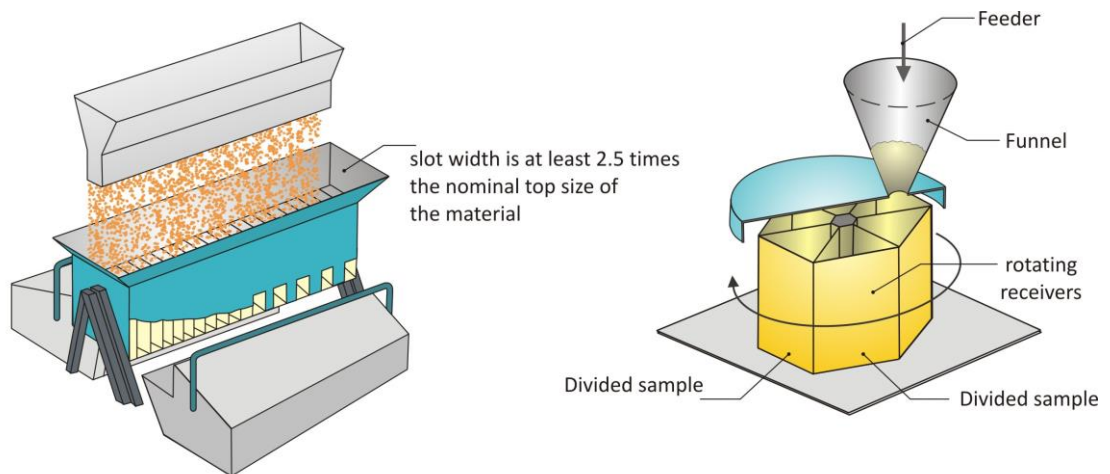


Example of riffle box

Example of a rotary sample divider

Figure 4. Example of a riffle divider and a rotating divider. Drawing: VTT

If a sample divider is not available, the sample can also be divided manually using the coning and quartering method presented in Figure 5. Mix the sample carefully all the way to the bottom, and pour the entire sample into a cone on a table or a suitable plate with a reasonably rapid motion. Then divide the sample into four parts of equal size using a suitable tool. Select two quarters for the sample in accordance with

Figure 5 (the diagonally opposite quarters). The remaining segments can also be quartered again, if the remaining sample volume is too large after a single quartering. In such a case the sample must be carefully mixed before the second quartering.

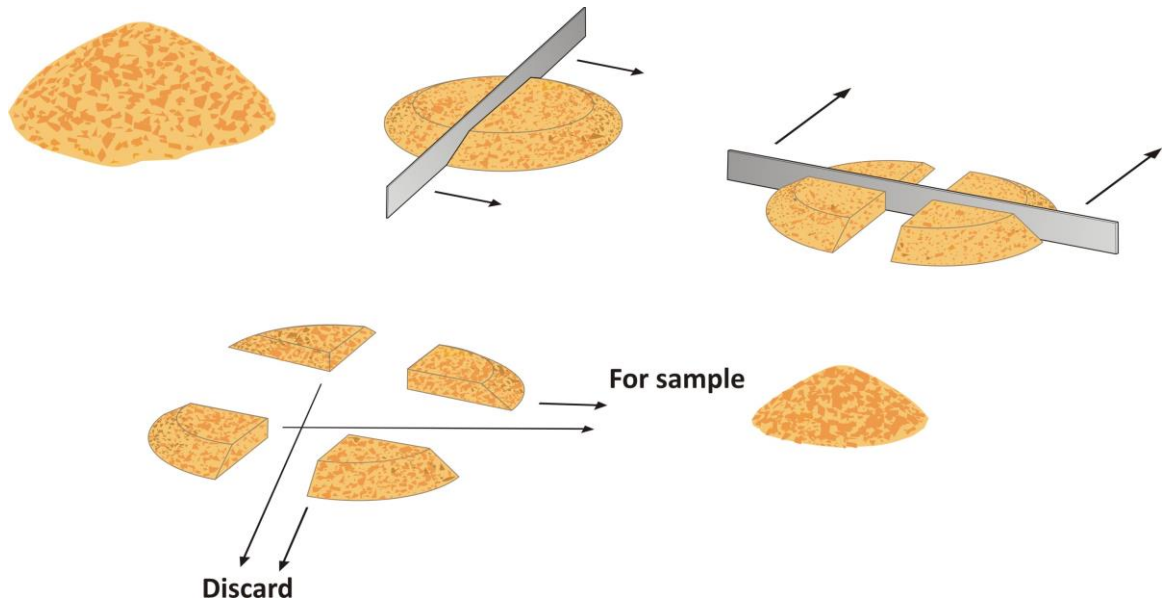

*Figure 5. The coning and quartering method can be used to first divide the sample into four segments, the diagonally opposite of which are rejected. Quartering is continued until a suitable sample volume is achieved. Drawing: VTT*

When the volume of the combined sample increases, we recommend mixing the sample using mechanical equipment – either specially designed mixers or cement mixers in the plants. After mixing, the process should be continued using mechanical dividers, such as a riffle box. At all stages of sample processing, care must be taken to avoid segregation by particle size (coarse particles, fines/ash content). There is also a need to ensure that the equipment is cleaned of both fuel and moisture residues between uses.

When manual sampling is used, the previous sample collector must clean the sample processing table, and the next sample collector must ensure that no sample materials or moisture remain on the table from the previous sampling.

## 10. Legal provisions governing measuring

The Finnish Timber Measurement Act (414/2013) is applied to the delivery, work and contract measurement of unrefined timber. The unrefined timber referred to in the Act comprises timber assortments manufactured from stemwood, bark, branches, stumps and roots regardless of the purpose of use. The allowed processing methods are: cutting, chipping and crushing. Industrial wood chips from sawmills and plywood plants, and sawdust lots of over 20 m<sup>3</sup> of loose volume are also covered by the Act. The Act came into force on 1 July 2013, and it has been applied to the measurement of energy wood assortments since 1 January 2014.

Measurements carried out in accordance with the Timber Measurement Act yield the final results in units of volume, weight or quantity. The determination of, for example, solid volume, bulk volume, weight or dry weight, and the required measurements including moisture measurement, are covered by the Act. The Act is not applied to the determination of energy content or calorific value. The Timber Measurement Act contains provisions on what must be agreed upon regarding the measurement, who performs the measurement, how the reliability of the measurement is ensured, what are the requirements on the measurement methods and equipment, how the measurements are documented, and how the measurement results are reported to the measurement parties. Furthermore, the Act lays down the organisations and procedures for the enforcement of the Act, development of measurement operations, resolution of measurement disputes, and appeals.

Decree of the Ministry of Agriculture and Forestry (12/13) also lays down provisions on the requirements on measurement methods and equipment, and carrying out measurements. The decree includes, for example, the measurement principles and content of the measurement methods used in timber measurement (measurement method groups), procedures for ensuring the reliability of the measurements, the maximum allowed deviations in the measurements, and the general requirements for measurement equipment. The Act stipulates that the general conversion factors related to timber measurement are issued by a decree of Natural Resources Institute Finland (1/2013). The decree includes conversion factors related to harvester measuring, the measuring of timber logs and piles, and conversions between weight and volume.

The Timber Measurement Act is applied to the weighing of timber using automatic weighing instruments. The Act on Measurement Equipment (707/2011) is applied to the weighing of timber using non-automatic weighing instruments; it is the general act for measuring.

The Sustainability Act (393/2021, RED II) includes provisions on the sustainability also for solid biofuels. Energy Authority is the competent authority, which makes decisions on the classification of raw materials on the basis of applications submitted by the operators. This classification has an impact on for example taxation and on applicable sustainability requirements. Detailed sustainability guidelines will be published in 2021.

## Literature

Act on Measurement Equipment, 707/2013. Statutes of Finland, 17.6.2011.

<http://finlex.fi/fi/laki/alkup/2011/20110707>

Alakangas, E. 2012. Analysis of particle size of wood chips and hog fuel – ISO/TC 238. VTT-R-02834-12. 28 p.

Alakangas, E. 2014. Käytöstä poistetun puun luokittelun soveltaminen käytäntöön - VTT-M-01931-14 [Practical application of the classification of used wood]. 51 p. VTT, Finnish Energy, Finnish Forest Industries Federation and the Bioenergy Association of Finland. In Finnish

Alakangas, E. 2014. Puupolttoaineiden laatuohje, VTT-M-07608-13 – päivitys 2020. 55 p. VTT, Finnish Energy, Finnish Forest Industries Federation and the Bioenergy Association of Finland. in Finnish

Alakangas, E., Hurskainen, M., Laatikainen-Luntama, J. & Korhonen, J. 2016. Properties of indigenous fuels in Finland, VTT Technology 272, 222 p.+ app. 23 p. <http://www.vtt.fi/inf/pdf/technology/2016/T272.pdf>.

Alakangas, E., Koponen, K. Sokka, L. & Keränen, J. Classification of used wood to biomass fuel or solid recycled fuel and cascading use in Finland, Book of Proceeding Bioenergy 2015, p. 79 – 86, For Boost for Entire Bioenergy Business, 2 – 4.9.2015, Jyväskylä, Finland

Biopolttoaineita, bionesteitä ja biomassapolttoaineita koskeva toiminnanharjoittajan kestävyyskriteeriohje [Sustainability guidelines for biofuels, bio-oils and solid biofuels for operators], Energy Authority 2021, 109 p. in Finnish

Decree of the Finnish Forest Research Institute on the general conversion factors related to timber measurement. Decrees of Ministries, Decree of the Finnish Forest Research Institute 1/2013, Docno. 498/62/2013. <http://www.finlex.fi/data/normit/41201->

[Metsantutkimuslaitoksen maarays puutavaran mittaukseen liittyvistä yleisistä muuntoluvuista FI 27 062013.pdf](http://www.finlex.fi/data/normit/41201-062013.pdf)

Decree of the Ministry of Agriculture and Forestry on the detailed content of the timber measurement groups and measurement methods and the use of measuring equipment. Decrees of Ministries, Decree of the Ministry of Agriculture and Forestry No. 12/13, 17.6.2013. <http://finlex.fi/data/normit/41198-13012fi.pdf>

Directive (EU) 2015/2193 of the European Parliament and of the Council of 25 November 2015 on the limitation of emissions of certain pollutants into the air from medium combustion plants.

European List of Waste - 2000/532/EC [Classification of wastes]

Government Decree on Non-automatic measurement instruments, 400/2012. Statutes of Finland, 28.6.2012. <http://finlex.fi/fi/laki/alkup/2012/20120400>

Heikurainen, M, Routa, J., Rintala, P., Mäkelä, M., Saarentaus, T., Immonen, K., Sirviö, J, Jaakkola, S, Palojärvi, K, Laiho, J, Hongisto, T. 2020. Puutavaran mittauksen toimikunta [Energy wood measurement guide, Board of wood measurement]. 30 p. in Finnish

Notices from European Union institutions, bodies, offices and agencies European Commission - Commission notice on technical guidance on the classification of waste. Official Journal of the European Union, 9.4.2018 p.124 – 134

SFS-EN 12952-15:en, Water-tube boilers and auxiliary installations – Part 15: Acceptance tests.

SFS-EN ISO 16559, Solid biofuels. Terminology, definitions and descriptions

SFS-EN ISO 17225-1, Solid biofuels. Fuel specifications and classes. Part 1: General requirements

SFS-EN ISO 17225-4, Solid biofuels. Fuel specifications and classes. Part 4: Graded wood chips

SFS-EN 15234-1, Solid biofuels. Fuel quality assurance. Part 1: General requirements

SFS-EN 15234-4, Solid biofuels. Fuel quality assurance. Part 4: Wood chips for non-industrial use

SFS-EN ISO 18135, Solid biofuels. Sampling

SFS-EN ISO 14780, Solid biofuels. Sample preparation

Thierry Lecomte, José Félix Ferrería de la Fuente, Frederik Neuwahl, Michele Canova, Antoine Pinasseau, Ivan Jankov, Thomas Brinkmann, Serge Roudier, Luis Delgado Sancho 2017. Best Available Techniques (BAT) Reference Document for Large Combustion Plants Industrial Emissions Directive 2010/75/EU (Integrated Pollution Prevention and Control)

Timber Measurement Act, 414/2013. Statutes of Finland, 17.6.2013, 15 p. (<http://finlex.fi/fi/laki/alkup/2013/20130414>)

Valtioneuvoston asetus keskisuurten energiantuotantoyksiköiden ja -laitosten (1 – 50 MW) ympäristönsuojeluvaatimuksista. [Decree of environmental requirements for medium-sized energy units and plants (1 – 50 MW). Suomen säädöskokoelma 1065/2017. 29.12.2017. in Finnish

Äijälä, O., Kuusinen, M. & Koistinen, A. 2010. Hyvän metsänhoidon suositukset energiapuun korjuuseen ja kasvatukseen [Recommendations for forest management for energy wood harvesting and growing]. Publications of Tapio. 31 p. in Finnish

## **Annexes**

Annex 1. Classification of wood raw materials

Annex 2. Examples of product declarations of various wood fuels

Annex 3. Determination of particle size

Annex 4. Determination of moisture

Annex 5. Net calorific value as received – calculation

Annex 6. Determination of bulk density

Annex 7. Example of the sampling and sample preparation for wood fuels

Annex 8. Number of increments

Annex 9. Quality diagram for wood fuels



## Annex 1 – Classification of wood raw materials (1.1 and 1.2) in accordance with standard SFS-EN ISO 17225-1

(Table published with permission from SFS)

1.1 Forest, plantation and other virgin wood	1.1.1 Whole trees without roots	1.1.1.1 Broad-leaf
		1.1.1.2 Coniferous
		1.1.1.3 Short rotation coppice
		1.1.1.4 Bushes
		1.1.1.5 Blends and mixtures
	1.1.2 Whole trees with roots	1.1.2.1 Broad-leaf
		1.1.2.2 Coniferous
		1.1.2.3 Short rotation coppice
		1.1.2.4 Bushes
		1.1.2.5 Blends and mixtures
	1.1.3 Stemwood	1.1.3.1 Broad-leaf with bark
		1.1.3.2 Coniferous with bark
		1.1.3.3 Broad-leaf without bark
		1.1.3.4 Coniferous without bark
		1.1.3.5 Blends and mixtures
	1.1.4 Logging residues	1.1.4.1 Fresh/Green, Broad-leaf (including leaves)
		1.1.4.2 Fresh/Green, Coniferous (including needles)
		1.1.4.3 Stored, Broad-leaf
1.1.4.4 Stored, Coniferous		
1.1.4.5 Blends and mixtures		
1.1.5 Stumps/roots	1.1.5.1 Broad-leaf	
	1.1.5.2 Coniferous	
	1.1.5.3 Short rotation coppice	
	1.1.5.4 Bushes	
	1.1.5.5 Blends and mixtures	
1.1.6 Bark (from forestry operations)		
1.1.7 Segregated wood from gardens, parks, roadside maintenance, vineyards, fruit orchards and driftwood from freshwater		
1.1.8 Blends and mixtures		
1.2 By-products and residues from wood processing industry	1.2.1 Chemically untreated wood by-products and residues	1.2.1.1 Broad-leaf with bark
		1.2.1.2 Coniferous with bark
		1.2.1.3 Broad-leaf without bark
		1.2.1.4 Coniferous without bark
		1.2.1.5 Bark (from industry operations)
	1.2.2 Chemically treated wood by-products, residues, fibres and wood constituents	1.2.2.1 Without bark
		1.2.2.2 With bark
		1.2.2.3 Bark (from industry operations)
		1.2.2.4 Fibres and wood constituents
	1.2.3 Blends and mixtures	

### Examples:

Fresh/green logging residues, spruce – 1.1.4.2

Stumps/roots, spruce – 1.1.5.2

Stemwood, mixture of broad-leaf and coniferous (majority broad-leaf) – 1.1.3.1 & 1.1.3.2

Sawdust, spruce – 1.2.1.4

Cutter shavings, pine – 1.2.1.4

Bark, spruce – 1.2.1.5

Blend of cutter shavings, sawdust and bark – 50 vol-% 1.2.1.4 and 50 vol-% 1.2.1.5

## Annex 2 – Examples of product declarations of various wood fuels

The product declaration is prepared according to the minimum values, taking the typical range into consideration.

### Example 1. Product declaration for wood chips from delimbed stemwood

Product declaration based on standard SFS-EN ISO 17225-1			
Normative	Property	Unit	Property grades
	Raw material	-	1.1.3.1 Delimbed stemwood, broadleaf
	Location		Kyyjärvi, Finland
	Particle size, P	mm	P 45, F 10
	Moisture, M	% in mass	M 40
	Ash, A	% in mass dry	A 1.0
Informative	Bulk density, BD	kg/m <sup>3</sup>	BD 250
	Energy density, E	MWh/loose m <sup>3</sup>	E 0.80

The quality grade according to the fuel specification standard part 4 is A2.

### Example 2. Product declaration for wood chips from logging residue

Product declaration based on standard SFS-EN ISO 17225-1			
Normative	Property	Unit	Property grades
	Raw material	-	1.1.4.2 Fresh/green, logging residue, coniferous
	Location		Forssa, Finland
	Particle size, P	mm	PL 10, F 25
	Moisture, M	% in mass	M 55
	Ash, A	% in mass dry	A 5.0
Informative	Bulk density, BD	kg/m <sup>3</sup>	BD 400+ (408)
	Net calorific value as received, Q	MJ/kg	Q 7.0

### Example 3. Product declaration for hog fuel from stumps

Product declaration based on standard SFS-EN ISO 17225-1			
Normative	Property	Unit	Property grades
	Raw material	-	1.1.5.2 Stumps/root, coniferous
	Location		Forssa, Finland
	Particle size, P	mm	P 45, F 20
	Moisture, M	% in mass	M 45
	Ash, A	% in mass dry	A 10+ (11,5)
Informative	Bulk density, BD	kg/m <sup>3</sup>	BD 300
	Net calorific value as received, Q	MJ/kg	Q 8.3

### Example 4. Product declaration for sawdust

Product declaration based on standard SFS-EN ISO 17225-1			
Normative	Property	Unit	Property grades
	Raw material	-	1.2.1.4 Sawdust, coniferous
	Location	-	Hämeenkyrö, Finland
	Moisture, M	% in mass	M 55
	Ash, A	% in mass dry	A 0.5
	Net calorific value as received, Q	MJ/kg	Q 7.1
Informative	Bulk density, BD	kg/m <sup>3</sup>	BD 300 (estimation)
	Screening	-	not screened

### Example 5. Product declaration for bark

Product declaration based on standard SFS-EN ISO 17225-1			
Normative	Property	Unit	Property grades
	Raw material	-	1.2.1.5 Bark, coniferous
	Location		Hämeenkyrö, Finland
	Particle size, P	mm	P 45, F 20
	Moisture, M	% in mass	M 55+ (60)
	Ash, A	% in mass dry	A 10.0+ (10,5)
	Net calorific value as received, Q	MJ/kg	Q 5.5
	Shredding	-	shredded

### Example 6. Product declaration for a blend of cutter shavings, sawdust and bark

Product declaration based on standard SFS-EN ISO 17225-1			
Normative	Property	Unit	Property grades
	Raw material	-	20% in mass 1.2.1.4 Cutter shavings, 12% in mass sawdust, coniferous, 68% in mass 1.2.1.5 bark, coniferous
	Location	-	Jyväskylä, Finland
	Particle size, P	mm	P 45, F 20
	Moisture, M	% in mass	M 50
	Ash, A	% in mass dry	A 3.0
	Net calorific value as received, Q	MJ/kg	Q 8.5
	Scredding		shredded
Informative	Bulk density, BD	kg/m <sup>3</sup>	Cutter chips BD 150 Sawdust, BD 300 Bark, B D350

The blend in Example 6 is made at a terminal by piling the different wood fuels in turns, beginning with cutter shavings, followed by sawdust and bark in layers of a couple of tens of centimetres. The layers will be compacted when more fuel is loaded on top of them. To determine the amount of blend, the loaded amount is calculated based on the volume of the loader bucket. The weight is estimated using the bulk densities of each wood fuel. The bulk densities are measured in accordance with Annex 6 before mixing. Typical values can be used as the calorific value. When the blend is delivered to the buyer, moisture samples are usually taken from the load at the buyer's reception station in addition to weighing the load. The calorific value is analysed from the moisture sample.

In example 6 the blend comprises 36 vol.-% of cutter shavings (moisture ca. 10.0 % in mass), 11 vol.-% of sawdust (moisture 55.0 % in mass) and 53 vol.-% of bark (moisture 60%). The net calorific values of the different fractions as received are listed in Table 1. Ten bucket loads of cutter shavings, three of sawdust and 15 of bark are loaded. If the bucket has a scale, the weight of each lot can be measured, and the energy content calculated using the calorific value. If the bucket does not have a scale, and the volume of one bucket load is 9 m<sup>3</sup>, the weights are calculated using the densities mentioned in Example 6. The calculated average calorific value is 8.42 MJ/kg. When the calorific value from the plant is compared to this value, the final result can be corrected proportionally to the energy contents.


**Table 1. Calculating the energy content of the blend (Example 6)**

Fuel	Amount, bucket size m <sup>3</sup> x amount m <sup>3</sup>	Amount, m <sup>3</sup> x bulk density (kg/m <sup>3</sup> ), kg	Net calorific value as received, MJ/kg	Energy amount, MJ
Cutter shavings	9 x 10 = 90 m <sup>3</sup>	90 x 150 = 13 500 kg	16.86	227 610
Sawdust	9 x 3 = 27 m <sup>3</sup>	27 x 300 = 8 100 kg	7.25	58 725
Bark	9 x 15 = 135 m <sup>3</sup>	135 x 350 = 47 250 kg	6.21	293 423
Blend, total	Total 252 m <sup>3</sup>	Total 68 850 kg average bulk density 273 kg/m <sup>3</sup>	Average 8.42 MJ/kg Average moisture content 49.0 % in mass	579 758

## Annex 3 – Determination of particle size

### Determination of the particle size of wood chips in accordance with standard SFS-EN ISO 17827-1

Collect samples for sieve analysis in accordance with the sampling standard. The required sample size is at least 8 litres. The screening is carried out using a sieve with round holes. The sieves used have opening sizes of 3.15 mm, 16 mm, 45 mm and 63 mm in accordance with standard ISO 3310-2. The particle size distribution is determined using standard SFS-EN ISO 17827-1. The sample is screened through horizontally oscillating sieves used to mechanically sort the particles into descending size classes (Figure 1), i.e., the largest aperture is at the top and the smallest at the bottom. The sample is screened at less than 20% moisture, and the screening time is 15 minutes. The screening direction is changed occasionally. If necessary, the sample is dried in accordance with the instructions of the sampling standard. Material left on each sieve and the bottom container is weighed with a precision of 0.1 g. All particles over 100 mm in size are picked by hand. The particle size analysis is recommended to be commissioned to a specialised laboratory.

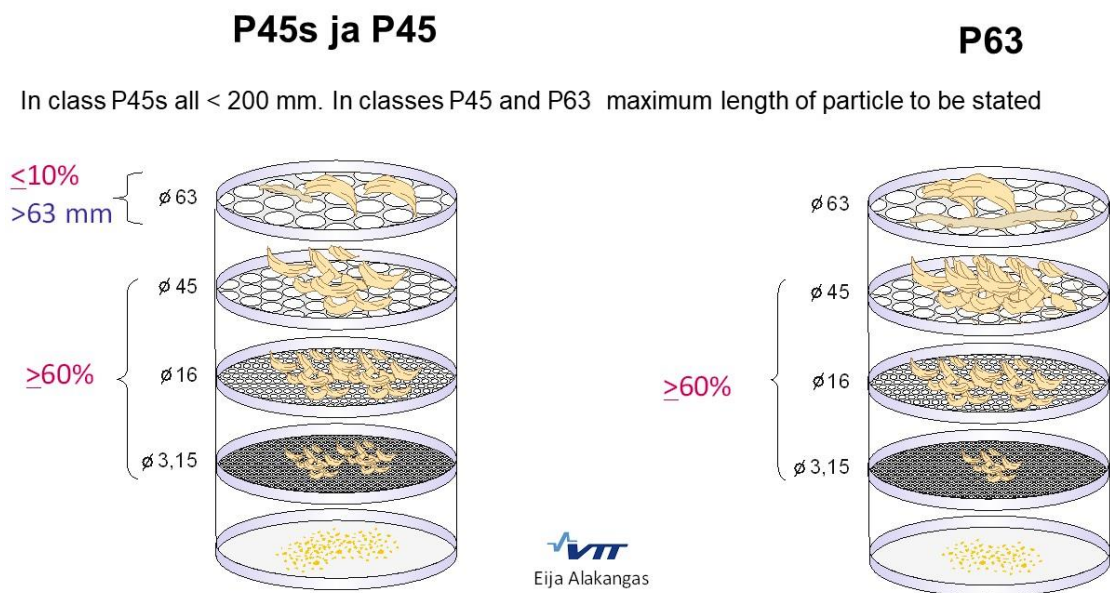

In class P45s fines (< 3,15 mm) is F10 ( $\leq 10\%$ ) and in classes P45 and P63 fines are stated as classes F02, F05, F10, F15, F20, F30 and F30+

Figure 1. Determination of particle size and quality requirements for classes P45s, P45 and P63. Drawing: VTT/Eija Alakangas.

The names of the particle size classes in the fuel specification standard parts 1 and 4 refer to the main fraction (60% of the weight on the sieves). With P31, for example, the total weight of material left on the 3.15 mm, 16 mm and 31.4 mm sieves is calculated into the 60% in mass main fraction. The maximum allowed amount of particles over 45 mm in size is 10% in mass, meaning that the maximum amount of fines is 30% in mass (F30). If the amount of fines is smaller, the main fraction comprises over 60% in mass of the material, as it turns out in the example on the next page and Figure 2.

In Figure 1, the letter s after the particle size class means 'small', and this particle size class is intended for small facilities.

The informative annex of the particle size determination standard includes the determination of the median value ( $d_{50}$ ). It is a value that divides the distribution into two equally sized parts and that is graphically the intersection point of the cumulative size distribution curve at the 50% horizontal line.

### Example 1: Particle size analysis of whole tree chips

Raw material for wood chips is whole trees without roots 1.1.1, particle size class is P45, F20. Maximum length of particle is 100 mm.

Screen, mm	Fines	Main fraction			Coarse fraction			Max. length, mm
	< 3,15 mm	3,15-16 mm	16-31,5 mm	31,5-45 mm	45-63 mm	63-100 mm	> 100 mm	
mass on screen, % in mass	16,1	46,7	0,0	31,1	3,4	2,7	0	100

For P45 Coarse fraction (particles  $\geq 63$  mm) should be  $\leq 10$  %. In this case coarse fraction is 2,7 %.

### Example 2a. Particle size analyses of fresh logging residues chips, % in mass (Alakangas 2012).

Screen, mm	Fresh logging residue, % in mass								
	1	2	3	4	5	6	7	8	9
< 3,15	19,5	25,6	33,7	28,3	32,8	24,2	25,1	6,9	6,0
3,15–16	23,2	40,2	40	47,6	46,2	64	52,3	31,7	38,8
16-31,5	13,4	25,7	17,2	17,2	12,8	8,3	16,8	7,5	39,6
31,5-45	10,5	4,8	2,9	1,7	4,7	0,7	3,4	4	8,6
45-63	8,2	3,8	6,3	5,2	0	2,8	2,4	49,9	7,9
> 100	25,2	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0
Particle size class	PL30, F20	P31, F30	P63, F30+ (33,7)	P31, F30	P31, F30+ (32,8)	P31, F25	P31, F30	P63, F10	P31, F10

### Example 2b. Particle size analyses of seasoned logging residue chips, % in mass (Alakangas 2012).

NOTE: Fines (< 3.15) can be higher than 30% for seasoned logging residue chips.

Screen, mm	Seasoned logging residue chips, % in mass			
	1	2	3	4
< 3,15	30,5	41,9	20,4	22,2
3,15–16	41,2	48,7	62,7	62,3
16–31,5	0	0	0	0
31,5–45	26,4	7,8	16,1	15
45–63	1,8	1,7	0,9	0,4
> 100	0,0	0,0	0,0	0,0
Particle size class	P45, F30+ (30.5)	PL 10, F30+ (41.9)	P16, F25	P16, F25

## Annex 4 – Determination of moisture

Determining the moisture of wood chips in accordance with standard SFS-EN ISO 18134-2



Figure 1. Moisture samples in a drying oven. Photo: Labtium Oy

Collect the samples in accordance with the sampling standard. The basic principle of sample reduction is that the composition of the sample must not change from the original during the different steps. The sample is reduced in accordance with the sample preparation standard. Mix the sample before preparation. Weigh the sample using scales with a precision of at least 0.1 g. Also weigh the empty drying container (=  $m_1$ ).

The sample size must be at least 300 g for wood chips and hog fuel. The sample layer must not be too thick. The particle size of the sample during moisture determination should be no more than 31,5 mm (nominal top size). Mark the sample with a unique identifier.

Dry the sample in an oven at a temperature of  $105^{\circ}\text{C} \pm 2^{\circ}\text{C}$ . The oven's ventilation valve (exhaust valve) must be open, and the humid air must be able to exit through it without hindrance. Monitor the temperature regularly.

Place the sample into the oven immediately after weighing (weighing value  $m_2$ ). Be careful not to lose the sample materials! Do not position the samples too compactly, touching the walls, or on the bottom of the oven. Use an oven mitt when taking the sample out of the oven to prevent burns.

Dry until the sample reaches a weight that no longer changes, but not longer than 24 hours!

Weigh the sample immediately after taking it out of the oven (weighing value  $m_3$ ). Then, turn off the oven.

Calculate the moisture ( $M_{ar}$ ) wet basis using the following formula:

$$M_{ar} = (m_2 - m_3) / (m_2 - m_1) \times 100$$

$M_{ar}$  moisture as received, % in mass

$m_1$  weight of the drying container, g

$m_2$  the combined weight of the drying container and sample before drying, g

$m_3$  the combined weight of the drying container and sample after drying, g

The result is reported with a precision of 0.1 percentage points. One determination is enough.

### Example:

$$M_{ar} = (582.47 - 456.96) / (582.47 - 281.13) \times 100 = 41.7 \% \text{ in mass}$$

## Annex 5 – Net calorific value as received – calculation

The net calorific value of dry matter can be determined in accordance with standard EN 14918/EN ISO 18125, or a jointly agreed typical net calorific values for different woods. **The typical calorific value** can be obtained from, for example, Annex B of the fuel specification standard part or Alakangas, E. 2016.

The net calorific value (at constant pressure) as received  $q_{p,net,ar}$  (wet biofuel) can be calculated, when the net calorific value on dry basis  $q_{p,net,d}$  and moisture as received  $M_{ar}$  are known using the following formula:

$$q_{p,net,ar} = q_{p,net,d} \times (100 - M_{ar}) / 100 - 0.02443 \times M_{ar}$$

The result is reported with a precision of 0.01 MJ/kg.

### Example:

#### Basic information:

Raw material: Logging residue 1.1.4.2

Net calorific value on dry basis:

- **Analysis** in accordance with SFS-EN ISO 18125  $q_{p,net,d} = 19.50$  MJ/kg
- **Typical value** (Table B.3; SFS-EN ISO 17225-1):  $q_{p,net,d} = 19.20$  MJ/kg  
(typical range, Table B.3; SFS-EN ISO 17225-1): ( $q_{p,net,d} = 18.5 - 20.5$  MJ/kg)

Moisture:

- Analysis in accordance with SFS-EN ISO 18134-2  $M_{ar} = 59.7\%$

#### Net calorific value as received:

$$q_{p,net,ar} = 19.50 \times ((100 - 59.7) / 100) - 0.02443 \times 59.7 = 6.40 \text{ MJ/kg (based on an analysis)}$$

$$q_{p,net,ar} = 19.20 \times ((100 - 59.7) / 100) - 0.02443 \times 59.7 = 6.28 \text{ MJ/kg (based on the use of a typical calorific value)}$$

1 MJ/kg equals 0.2778 kWh/kg. The calculations use the unit MJ/kg, and the conversion to kWh/kg is done at the end of the calculation.

#### Calculation of energy density

If a unit of volume is used for the deliveries ( $m^3$  loose or stacked) and the bulk density has been measured, the energy density is calculated as follows:

$$E_{ar} = (q_{p,net,ar} / 3600) \times BD_{ar}$$

In this example, the bulk density was  $379.0 \text{ kg/m}^3$

$$E_{ar} = 6.40 / 3600 \times 379.0 \text{ MWh/m}^3 = 0.67 \text{ MWh/m}^3$$

## Annex 6 – Determination of bulk density

### Determining the bulk density of wood chips in accordance with standard SFS-EN ISO 17828

The ratio between the container height and diameter must be between 1.25 and 1.50. Use a so-called large container for wood chips and hog fuel with a volume of 50 litres (0.05 m<sup>3</sup>). Weigh using scales with a precision of at least 10 g. Also weigh the empty container. Perform the sampling and sample preparation in accordance with the corresponding standards. Determine the sample's moisture content as received in accordance with SFS-EN ISO 18134-2 immediately after the bulk density has been determined. In this way, the determination of bulk density and moisture can be combined, which is commonly done by smaller plants.



Mix the sample (sample amount a bit less than 70 litres). Fill the container by pouring from 20–30 cm above the top edge of the container until the highest possible heap has formed.



The filled container is dropped three times by letting it drop freely from a height of 15 cm to a wooden plate. Ensure that the container hits the wooden plate vertically. Refill the empty space created in the container.



Remove any extraneous material using a small batten moving over the container in swinging motions. If the sample contains coarse matter, all particles preventing the batten from moving freely must be removed by hand. If the removal of large particles makes largish pits in the levelled surface, fill them and repeat the removal of extraneous material.



Weigh the filled container. Combine the used sample with the unused sample matter, repeat the procedure, and then repeat the entire procedure at least once.

*Photos: VTT/Eija Alakangas*



Calculate the bulk density (BD) using the following formulas:

$$BD_{ar} = (m_2 - m_1)/V$$

$$BD_d = BD_{ar} \times (100 - M_{ar})/100$$

where

$BD_{ar}$  is the bulk density as received,  $kg/m^3$

$BD_d$  is the bulk density on dry basis,  $kg/m^3$

$m_1$  is the weight of an empty container, kg

$m_2$  is the weight of a filled container, kg

$V$  is the net volume of the measurement container,  $m^3$

$M_{ar}$  is the moisture as received, % in mass


The results of individual determinations are reported with a precision of  $0.1 kg/m^3$ . In the calculation of the average of individual results, the result is rounded to the nearest  $10 kg/m^3$ .

**Example:**

$$BD_{ar} = (18.845 - 3.160)/0.05 = 313.7 kg/m^3$$

$$BD_d = 313.7 \times (100 - 41.7)/100 = 182.9 kg/m^3$$

## Annex 7 – Example of the sampling and sample preparation for wood fuels

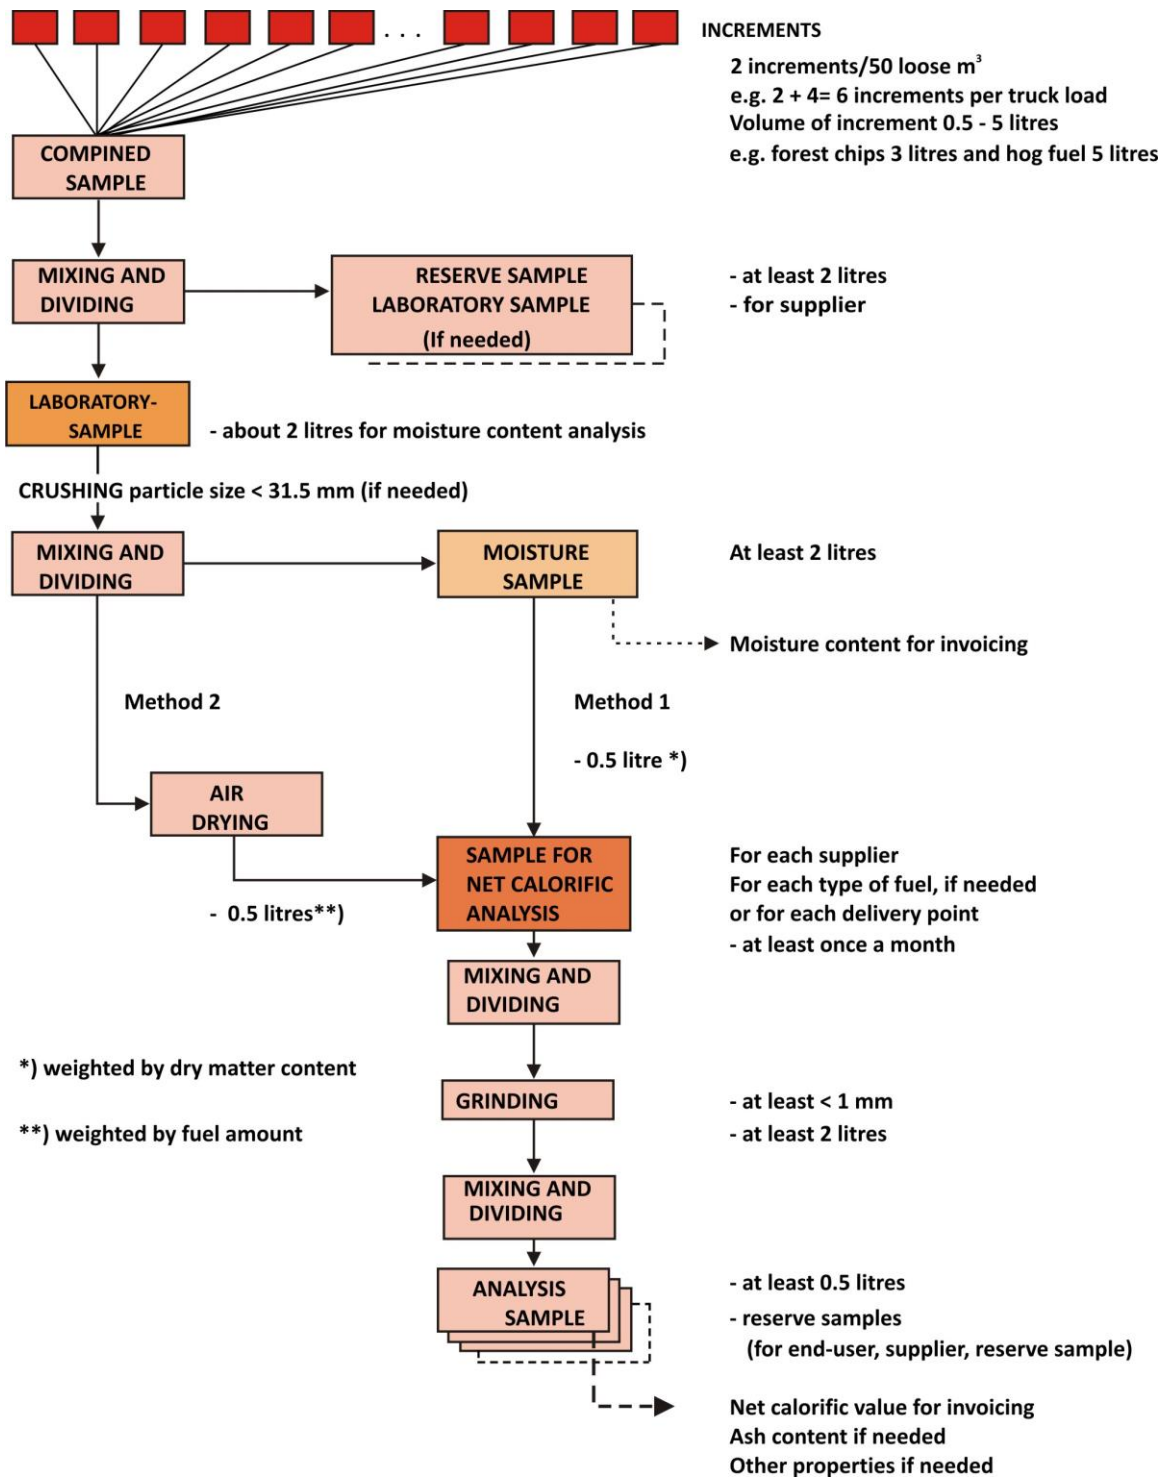

## Annex 8 – Number of increments

The minimum number of increments is calculated using the formula presented in the sampling standard

$$n = \frac{4V_I}{NP_L^2 - 4V_{PT}}$$

$n$  = the minimum number of increments;

$P_L$  = the desired overall precision including sampling, preparation and determination (analysis) at a 95% statistical confidence level;

$V_I$  = the primary variance between the increments (= square of the internal deviation,  $s_d^2$ )

$N$  = the number of sub-lots, or number of loads in Finland; and

$V_{PT}$  = variance of preparation and determination.

The overall sampling precision is affected most by both the delivered fuel lot's internal moisture deviation and its size, or the number of loads. The internal moisture deviations of various Finnish forest fuels have been analysed taking into consideration both seasonal variations and the geographical location of the plants. The deviations were largest with logging residue chips and whole-tree chips. The figure below presents the effect of the number of increments on the overall precision of sampling with regard to moisture. The parameter is the size of the delivery lot  $N$  (1 to 5 loads). The average deviation in logging residue chips during different seasons has been used as the internal moisture deviation ( $s_d = 4.92$  percentage points).


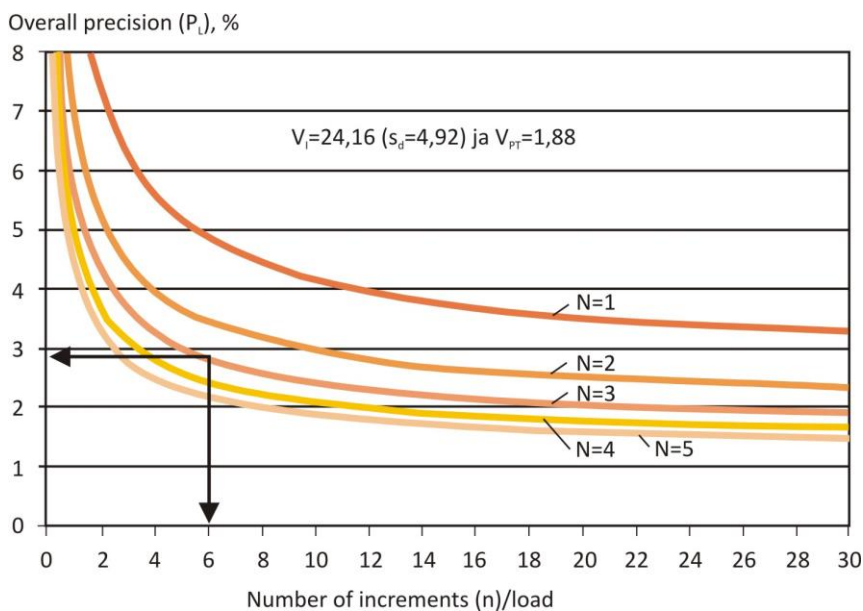


Figure 1. The dependency of the number of increments ( $n$ ) on the desired overall precision ( $P_L$ ) with the sub-lots ( $N$ ) as parameters with logging residue chips using the average seasonal deviation. Photo: VTT.

- When six increments are taken from a load, the overall precision is a bit under  $\pm 3$  percentage units, when the delivery lot comprises three loads
- The precision approaches  $\pm 2$  percentage units when the delivery lot increases to five loads.
- The changes in overall precision are large with small delivery lots (one to two loads) when the number of increments must be doubled in order to keep the overall precision tolerable.
- Variations in the internal deviation do not affect the shape of the graphs; with larger deviations, the family of curves in the figure moves upwards, i.e., the sampling precision decreases.
- For some forest fuel deliveries, it is characteristic that the seasons affect the moisture deviation in the delivery lot; for example, the deviation is significantly larger during winter than during summer.

## Annex 9 – Quality diagram for wood fuels

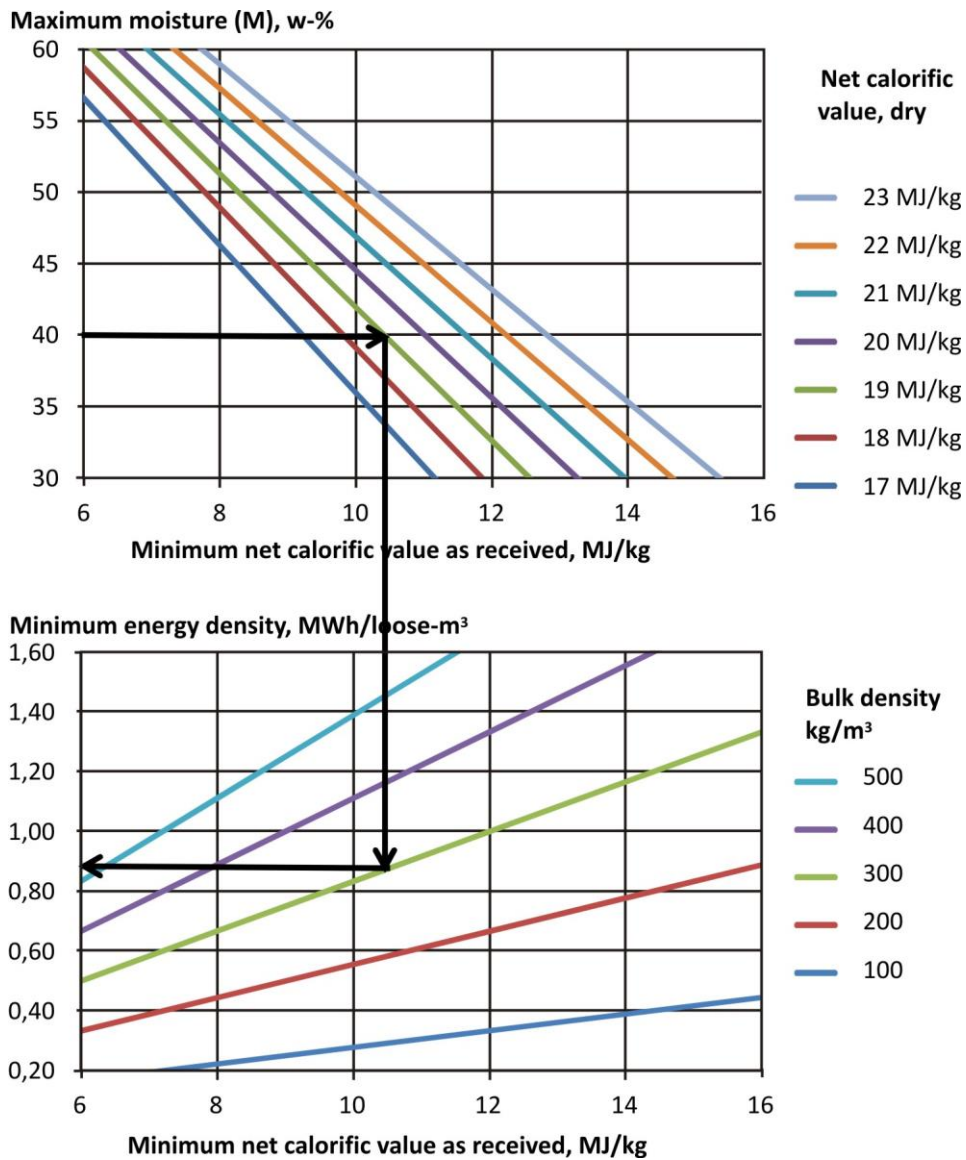

### Example:

Select 40% as the maximum moisture and 19 MJ/kg as the net calorific value on dry basis for the fuel

→ minimum net calorific value as received is 10.42 MJ/kg

Select 300 kg/m<sup>3</sup> as the minimum value of bulk density

→ minimum energy density is 0.86 MWh/m<sup>3</sup>

